



464 Valley Brook Avenue, Lyndhurst NJ 07071  
129 Sea Girt Avenue, Manasquan NJ 08736  
Phone: (800) 423-0766 • Fax: (201) 438-1798  
[www.mccabeenv.com](http://www.mccabeenv.com)

---

## LEAD IN DRINKING WATER TESTING REPORT

*Conducted for:*

Bayonne Board of Education  
669 Avenue A  
Bayonne, New Jersey 07002

*Conducted at:*

Henry Harris Community School  
135 Avenue C  
Bayonne, New Jersey 07002

*Submitted by:*

McCabe Environmental Services, L.L.C.  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

**REPORT DATE:** October 25, 2022

**MES PROJECT NO.:** 22-04448

*Prepared by:*

A handwritten signature in blue ink, appearing to read 'A. Capalbo'.

**Angela Capalbo**  
Environmental Scientist

*Signed for the Company by:*

A handwritten signature in blue ink, appearing to read 'John H. Chiaviello'.

**John H. Chiaviello**  
Vice President

## **TABLE OF CONTENTS**

	<b><u>Page</u></b>
1.0 INTRODUCTION .....	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS .....	2
5.0 DISCUSSION AND CONCLUSION .....	4

### **APPENDIX A**

Laboratory Certificates of Analysis  
&  
Sample Chain of Custody Forms

### **APPENDIX B**

School District Sampling Attachments

## **1.0     INTRODUCTION**

McCabe Environmental Services, L.L.C. (McCabe) was retained by Bayonne Board of Education (Client) to conduct lead in drinking water testing at the Henry Harris Community School located at 135 Avenue C, Bayonne, New Jersey.

The project information is as follows:

<u>Client Name:</u>	Bayonne Board of Education
<u>Contact Person:</u>	Mr. Daniel Castles
<u>Project Name:</u>	Henry Harris Community School Lead in Drinking Water
<u>Project Location:</u>	135 Avenue C Bayonne, New Jersey
<u>Date(s) of Service:</u>	August 31, 2022
<u>McCabe Personnel:</u>	Gerard D'Alessio

## **2.0     SCOPE OF WORK**

Drinking water testing was performed at the Henry Harris Community School located at 135 Avenue C, Bayonne, New Jersey on August 31, 2022. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead concentrations. Samples were collected from various potential drinking water outlets located throughout the building.

## **3.0     PROCEDURES**

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards.

**4.0 TABLE OF SAMPLE RESULTS**

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
HH-01	First Draw – Right Bubbler by Room 102	1	Pass	Pass
HH-02	30 Second Flush – Right Bubbler by Room 102	2.7	Pass	Pass
HH-03	First Draw – Left Bubbler by Room 102	2.1	Pass	Pass
HH-04	First Draw – Bubbler by Principal's Office	4.5	Pass	Pass
HH-05	First Draw – Main Office Faucet	0.9	Pass	Pass
<b>HH-06</b>	<b>First Draw – Pre-K Bathroom Sink, Left Side</b>	<b>166</b>	<b>Fail</b>	<b>Fail</b>
<b>HH-07</b>	<b>First Draw – Pre-K Bathroom Sink, Right Side</b>	<b>54.6</b>	<b>Fail</b>	<b>Fail</b>
<b>HH-08</b>	<b>First Draw – Lunchroom Faucet</b>	<b>59.9</b>	<b>Fail</b>	<b>Fail</b>
HH-09	First Draw – Left Bubbler by Lunchroom	6	Pass	Pass
HH-10	First Draw – Right Bubbler by Lunchroom	0.7	Pass	Pass
HH-11	First Draw – Pre-K Room 108 Sink	2.7	Pass	Pass
HH-12	First Draw – Pre-K Room 108 Bathroom Sink	< 0.5	Pass	Pass
HH-13	First Draw – Pre-K Room 107 Sink	0.7	Pass	Pass
HH-14	First Draw – Pre-K 107 Bathroom Sink	1.1	Pass	Pass
HH-15	First Draw – Pre-K Room 106 Bathroom Sink	< 0.5	Pass	Pass
HH-16	First Draw – Left Bubbler by Room 201	2.9	Pass	Pass
HH-17	First Draw – Right Bubbler by Room 201	2.3	Pass	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
HH-18	First Draw – Library Faucet	66.7	Fail	Fail
HH-19	First Draw – Faculty Room Faucet	1.3	Pass	Pass
HH-20	First Draw – Bubbler Across from Nurse’s Office	4	Pass	Pass
HH-21	First Draw – Nurse’s Office Faucet	4.2	Pass	Pass
HH-22	First Draw – Bubbler by Room 21	4	Pass	Pass
HH-23	First Draw – Left Bubbler by Room 20	2.9	Pass	Pass
HH-24	First Draw – Right Bubbler by Room 20	4.1	Pass	Pass
HH-25	First Draw – Copy Room Bubbler	1	Pass	Pass
HH-26	First Draw – Copy Room Sink	0.8	Pass	Pass
HH-27	First Draw – Bubbler by 302, Left Side	6.9	Pass	Pass
HH-28	First Draw – Bubbler by 302, Right Side	10.9	Pass	Pass
HH-29	First Draw – Bubbler Across Room 37	25.3	Fail	Fail
HH-30	First Draw – Bubbler by Room 31, Left Side	4.7	Pass	Pass
HH-31	First Draw – Bubbler by Room 31, Right Side	4.5	Pass	Pass
HH-32	First Draw – Chiller by Room 306	< 0.5	Pass	Pass
HH-33	First Draw – Bubbler Between 306 and 307	< 0.5	Pass	Pass
HH-34	First Draw – Sink Between 306 and 307	< 0.5	Pass	Pass

**5.0 DISCUSSION AND CONCLUSION**

A total of thirty-four (34) samples were collected from the Henry Harris Community School. Five (5) samples were found to be greater than the EPA Lead and Copper Rule standard of 15 ppb and also greater than the EPA Lead in Drinking Water at Schools and Child Care Facilities standard of 20 ppb. All other samples were found to be less than the EPA standards of 20 ppb and 15 ppb.

McCabe recommends discontinued usage of the following outlets which resulted in failed results until additional samples can be collected and analyzed and a permanent solution can be recommended:

- **Pre-K Bathroom Sink, Left Side**
- **Pre-K Bathroom Sink, Right Side**
- **Lunchroom Faucet**
- **Library Faucet**
- **Bubbler Across Room 37**

Proper signage shall be posted at the Library Office Sink identifying “Do Not Drink, Safe For Washing Hands.” This sign can be found in Appendix B.

To address the water quality in the short term, McCabe recommends that it may be appropriate to inspect piping near these fixtures to determine if any corrosion is evident and whether it is possible to replace portions of the piping.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building’s plumbing is not having an adverse impact on water quality.

**APPENDIX A**

**LABORATORY CERTIFICATES OF ANALYSIS  
&  
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, September 12, 2022

Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
SDG ID: GCM21427  
Sample ID#s: CM21427 - CM21460

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301  
CT Lab Registration #PH-0618  
MA Lab Registration #M-CT007  
ME Lab Registration #CT-007  
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003  
NY Lab Registration #11301  
PA Lab Registration #68-03530  
RI Lab Registration #63  
VT Lab Registration #VT11301





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21427

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
HH-01	CM21427	DRINKING WATER
HH-02	CM21428	DRINKING WATER
HH-03	CM21429	DRINKING WATER
HH-04	CM21430	DRINKING WATER
HH-05	CM21431	DRINKING WATER
HH-06	CM21432	DRINKING WATER
HH-07	CM21433	DRINKING WATER
HH-08	CM21434	DRINKING WATER
HH-09	CM21435	DRINKING WATER
HH-10	CM21436	DRINKING WATER
HH-11	CM21437	DRINKING WATER
HH-12	CM21438	DRINKING WATER
HH-13	CM21439	DRINKING WATER
HH-14	CM21440	DRINKING WATER
HH-15	CM21441	DRINKING WATER
HH-16	CM21442	DRINKING WATER
HH-17	CM21443	DRINKING WATER
HH-18	CM21444	DRINKING WATER
HH-19	CM21445	DRINKING WATER
HH-20	CM21446	DRINKING WATER
HH-21	CM21447	DRINKING WATER
HH-22	CM21448	DRINKING WATER
HH-23	CM21449	DRINKING WATER
HH-24	CM21450	DRINKING WATER
HH-25	CM21451	DRINKING WATER
HH-26	CM21452	DRINKING WATER
HH-27	CM21453	DRINKING WATER
HH-28	CM21454	DRINKING WATER
HH-29	CM21455	DRINKING WATER
HH-30	CM21456	DRINKING WATER



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21427

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

---

Client Id	Lab Id	Matrix
HH-31	CM21457	DRINKING WATER
HH-32	CM21458	DRINKING WATER
HH-33	CM21459	DRINKING WATER
HH-34	CM21460	DRINKING WATER



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

6:48  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21427

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

6:50  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21428

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

6:51  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21429

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

6:56  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21430

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:00  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21431

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:05  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21432

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	166	1.3	5	ppb	15			09/10/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:06  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21433

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	54.6	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:13  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21434

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	59.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/03/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:16  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21435

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	6	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Batch spiked with ICP spike. Fixed in data transfer CPP 091022

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:17  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21436

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:20  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21437

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:22  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21438

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:25  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21439

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:27  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21440

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-14

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:29  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21441

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-15

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:35  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21442

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-16

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:36  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21443

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-17

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.3	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:39  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21444

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-18

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	66.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:43  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21445

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-19

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.3	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

Batch spiked with ICP spike. Fixed in data transfer CPP 091022

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:45  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21446

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-20

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:49  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21447

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-21

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.2	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:52  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21448

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-22

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:53  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21449

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-23

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:54  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21450

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-24

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:57  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21451

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-25

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

7:58  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21452

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-26

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:03  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21453

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-27

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	6.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:04  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21454

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-28

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	10.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:06  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21455

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-29

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	25.3	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:09  
18:30

### Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21456

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-30

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:10  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21457

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-31

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:13  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21458

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-32

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:15  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21459

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-33

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:16  
18:30

## Laboratory Data

SDG ID: GCM21427  
Phoenix ID: CM21460

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: HH-34

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager

# Analysis Report - Summary

September 12, 2022

Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCM21427



Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
Project: 22-04448 Bayonne Board Of Education								
CM21427	HH-01	08/31/22	Lead	1	0.5	ppb	09/09/22	E200.8
CM21428	HH-02	08/31/22	Lead	2.7	0.5	ppb	09/09/22	E200.8
CM21429	HH-03	08/31/22	Lead	2.1	0.5	ppb	09/09/22	E200.8
CM21430	HH-04	08/31/22	Lead	4.5	0.5	ppb	09/09/22	E200.8
CM21431	HH-05	08/31/22	Lead	0.9	0.5	ppb	09/09/22	E200.8
CM21432	HH-06	08/31/22	Lead	166	1.3	ppb	09/10/22	E200.8
CM21433	HH-07	08/31/22	Lead	54.6	0.5	ppb	09/09/22	E200.8
CM21434	HH-08	08/31/22	Lead	59.9	0.5	ppb	09/09/22	E200.8
CM21435	HH-09	08/31/22	Lead	6	0.5	ppb	09/09/22	E200.8
CM21436	HH-10	08/31/22	Lead	0.7	0.5	ppb	09/09/22	E200.8
CM21437	HH-11	08/31/22	Lead	2.7	0.5	ppb	09/09/22	E200.8
CM21438	HH-12	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21439	HH-13	08/31/22	Lead	0.7	0.5	ppb	09/09/22	E200.8
CM21440	HH-14	08/31/22	Lead	1.1	0.5	ppb	09/09/22	E200.8
CM21441	HH-15	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21442	HH-16	08/31/22	Lead	2.9	0.5	ppb	09/09/22	E200.8
CM21443	HH-17	08/31/22	Lead	2.3	0.5	ppb	09/09/22	E200.8
CM21444	HH-18	08/31/22	Lead	66.7	0.5	ppb	09/09/22	E200.8
CM21445	HH-19	08/31/22	Lead	1.3	0.5	ppb	09/09/22	E200.8
CM21446	HH-20	08/31/22	Lead	4	0.5	ppb	09/09/22	E200.8
CM21447	HH-21	08/31/22	Lead	4.2	0.5	ppb	09/09/22	E200.8
CM21448	HH-22	08/31/22	Lead	4	0.5	ppb	09/09/22	E200.8
CM21449	HH-23	08/31/22	Lead	2.9	0.5	ppb	09/09/22	E200.8
CM21450	HH-24	08/31/22	Lead	4.1	0.5	ppb	09/09/22	E200.8
CM21451	HH-25	08/31/22	Lead	1	0.5	ppb	09/09/22	E200.8


Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
CM21452	HH-26	08/31/22	Lead	0.8	0.5	ppb	09/09/22	E200.8
CM21453	HH-27	08/31/22	Lead	6.9	0.5	ppb	09/09/22	E200.8
CM21454	HH-28	08/31/22	Lead	10.9	0.5	ppb	09/09/22	E200.8
CM21455	HH-29	08/31/22	Lead	25.3	0.5	ppb	09/09/22	E200.8
CM21456	HH-30	08/31/22	Lead	4.7	0.5	ppb	09/09/22	E200.8
CM21457	HH-31	08/31/22	Lead	4.5	0.5	ppb	09/09/22	E200.8
CM21458	HH-32	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21459	HH-33	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21460	HH-34	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8

Comments:

Sample: CM21435  
Batch spiked with ICP spike. Fixed in data transfer CPP 091022

Sample: CM21445  
Batch spiked with ICP spike. Fixed in data transfer CPP 091022

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.  
ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit

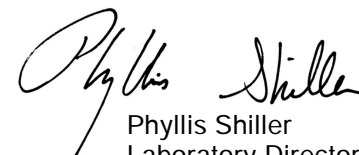  
Phyllis Shiller  
Laboratory Director  
September 12, 2022



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



# QA/QC Report

September 12, 2022


## QA/QC Data

SDG I.D.: GCM21427

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
QA/QC Batch 640587A (mg/L), QC Sample No: CM21425 2X (CM21427, CM21428, CM21429, CM21430, CM21431, CM21432, CM21433, CM21434)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001				105			98.6				
Comment: This batch does not include a duplicate.													
QA/QC Batch 640616 (mg/L), QC Sample No: CM21435 2X (CM21435, CM21436, CM21437, CM21438, CM21439, CM21440, CM21441, CM21442, CM21443, CM21444)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001	0.0060	0.0058	3.40	108			106				
QA/QC Batch 640616A (mg/L), QC Sample No: CM21445 2X (CM21445, CM21446, CM21447, CM21448, CM21449, CM21450, CM21451, CM21452, CM21453, CM21454)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001				108			109				
Comment: This batch does not include a duplicate.													
QA/QC Batch 640617 (mg/L), QC Sample No: CM21455 2X (CM21455, CM21456, CM21457, CM21458, CM21459, CM21460)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001	0.0253	0.0256	1.20	103			96.6				

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

RPD - Relative Percent Difference  
LCS - Laboratory Control Sample  
LCSD - Laboratory Control Sample Duplicate  
MS - Matrix Spike  
MS Dup - Matrix Spike Duplicate  
NC - No Criteria  
Intf - Interference

  
Phyllis Shiller, Laboratory Director  
September 12, 2022

Monday, September 12, 2022

Criteria: NJ: DW

State: NJ

## Sample Criteria Exceedances Report

### GCM21427 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
CM21432	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	166	1.3	15	1	ppb
CM21433	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	54.6	0.5	15	1	ppb
CM21434	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	59.9	0.5	15	1	ppb
CM21444	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	66.7	0.5	15	1	ppb
CM21455	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	25.3	0.5	15	1	ppb

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.





**Environmental Laboratories, Inc.**  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Comments

September 12, 2022

SDG I.D.: GCM21427

---

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

# McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lynnhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

2.5°C wcap

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Henry Harris Community School 135 Avenue C, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard DAlessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 08/31/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HH-01	First draw - Right Boubler by Room 102	0648	LEAD - 200.8
DW	HH-02	30 second Flush - Right boubler by Room 102	0650	LEAD - 200.8
DW	HH-03	First draw - Left boubler by Room 102	0651	LEAD - 200.8
DW	HH-04	First draw - Boubler by Principal Office	0656	LEAD - 200.8
DW	HH-05	First draw - Main office faucet	0700	LEAD - 200.8
DW	HH-06	First draw - Prek Bathroom sink - Left	0705	LEAD - 200.8
DW	HH-07	First draw - Prek Bathroom sink - Right	0706	LEAD - 200.8
DW	HH-08	First draw - Lunch room faucet	0713	LEAD - 200.8
DW	HH-09	First draw - Left Boubler by Lunch Room	0716	LEAD - 200.8
DW	HH-10	First draw - Right Boubler by Lunch Room	0717	LEAD - 200.8

Relinquished by (Print) Gerard DAlessio	Date:	Time:	Received by: (Print) <i>Gerard DAlessio</i>	Date:	Time:
Signature: <i>Gerard DAlessio</i>			Signature: <i>Gerard DAlessio</i>		
Relinquished by (Print) <i>Blair Catfish</i>	Date:	Time:	Received by: (Print)	Date:	Time:
Signature: <i>Blair Catfish</i>			Signature: <i>Trudy A</i>	9/1/22	1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

# McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lyndhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Henry Harris Community School 135 Avenue C, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 08/31/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HH-11	First draw - Prek Room 108 Sink	0720	LEAD - 200.8 21437
DW	HH-12	First draw - Prek Room 108 Bathroom Sink	0722	LEAD - 200.8 21438
DW	HH-13	First draw - Prek Room 103 Sink	0725	LEAD - 200.8 21439
DW	HH-14	First draw - Prek Room 103 Bathroom Sink	0727	LEAD - 200.8 21440
DW	HH-15	First draw - Prek Room 106 Bathroom Sink	0729	LEAD - 200.8 21441
DW	HH-16	First draw - Left bubbler by Room 201	0735	LEAD - 200.8 21442
DW	HH-17	First draw - Right bubbler by Room 201	0736	LEAD - 200.8 21443
DW	HH-18	First draw - Library Faucet	0739	LEAD - 200.8 21444
DW	HH-19	First draw - Faculty Room Faucet	0743	LEAD - 200.8 21445
DW	HH-20	First draw - Bubbler across from the Nurse	0745	LEAD - 200.8 21446

Relinquished by (Print) Gerard D'Alessio	Date:	Time:
Signature: Gerard D'Alessio	Received by: (Print) <i>[Signature]</i>	Time: 2:06
Relinquished by (Print) <i>[Signature]</i>	Signature: <i>[Signature]</i>	Date:
Signature: <i>[Signature]</i>	Received by: (Print) <i>[Signature]</i>	Time: 1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

# MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

2.5% wip

## LEAD in DRINKING WATER CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Henry Harris Community School 135 Avenue C, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: <i>Getachew D. Alemsegn</i>		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 08/31/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HH-21	First draw - Nurse's office Faucet	0749	LEAD - 200.8
DW	HH-22	First draw - Bubble by Room 21	0752	LEAD - 200.8
DW	HH-23	First draw - Left bubbler by Room 20	0753	LEAD - 200.8
DW	HH-24	First draw - Right bubbler by Room 20	0754	LEAD - 200.8
DW	HH-25	First draw - COPY ROOM Sink Bubbler	0757	LEAD - 200.8
DW	HH-26	First draw - COPY ROOM Sink	0758	LEAD - 200.8
DW	HH-27	First draw - Bubbler by 302 - Left	0803	LEAD - 200.8
DW	HH-28	First draw - Bubbler by 302 Right	0804	LEAD - 200.8
DW	HH-29	First draw - Bubbler by Cross Room 37	0806	LEAD - 200.8
DW	HH-30	First draw - Bubbler by Room 31-Left	0809	LEAD - 200.8

Relinquished by (Print) <i>Getachew D. Alemsegn</i>	Date:	Received by: (Print) <i>Andi Cox</i>	Date:
Signature: <i>Getachew D. Alemsegn</i>	Time:	Signature: <i>Andi Cox</i>	Time: 206
Relinquished by (Print) <i>Andi Cox</i>	Date:	Received by: (Print)	Date:
Signature: <i>Andi Cox</i>	Time:	Signature: <i>Emily</i>	Time: 1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

# McCabe Environmental Services, L.L.C.

464 VALLEY BROOK AVENUE LYNDBURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Henry Harris Community School 135 Avenue C, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 08/31/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HH-31	First draw - Bubble by Room 31	0810	LEAD - 200.8
DW	HH-32	First draw - Chiller by Room 306	0813	LEAD - 200.8
DW	HH-33	First draw - Between 306 and 307 Bubble	0815	LEAD - 200.8
DW	HH-34	First draw - Between 306 and 307 Sink	0816	LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Received by: (Print) <i>hars...</i>	Date:	Time:
Signature: <i>Gerard D'Alessio</i>	Signature: <i>Bud...</i>	9/1/22	1830
Relinquished by (Print) <i>Bud...</i>	Received by: (Print) <i>Emily...</i>	Date:	Time:
Signature: <i>Bud...</i>	Signature: <i>Emily...</i>	9/1/22	1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE

**APPENDIX B**

**SCHOOL DISTRICT SAMPLING  
ATTACHMENTS**

### Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Henry Harris Community School	08/31/2022	Phoenix Environmental Laboratories Inc.	

## Attachment B - Plumbing Profile

**Note:** Complete for each school. For additional information see the USEPA publication, "The 3Ts for Reducing Lead in Drinking Water in Schools"

Name of School: Henry Harris Community Sch Grade Levels: K-8

Address: 135 Avenue C, Bayonne, NJ 07002

Individual school project officer Signature:  Date: August 2022

Questions		Answers
Background Information		
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	K-8 Grade School Built in 1920 First Addition was added in 1975 Next Addition was added in 2000	
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Any repairs made after 1986 were done using lead free solder	
3. Where are the most recent plumbing repairs and replacements?	Location: House 5 Nurse Office Art Room Teachers Room Library	Description: Faucet Faucet Faucet Faucet Replace Fountains
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	Material: Main Building - Duct Iron  Location: The water main (5th St) enters the first floor flows through building to the custodial room where the water meter is located and continues to the remainder of the building	
5. Is there point of entry (POE) or point of use (POU) treatment in use?	Y / N Type: at POE No treatment of water City water comes treated	Location: Main Building 1920



Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N YES - Building has a 75 gallon hot water storage tank. Boiler Room 40 Gallon Hot water tank sub basement 38 Gallon Hot water tank new wing
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	Yes, Scott Nolan, Andy McCabe, Vinny Caiola, change filters on an as needed basis assign plumbers Change on an as needed basis
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N YES The district has set up a routine maintenance program to clean screens
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N No Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: <ul style="list-style-type: none"> <li>• Name of contaminant(s)</li> <li>• Concentrations found</li> <li>• pH level</li> </ul> Is testing done regularly at the building?	No indoor testing by public water supplier
11. Other plumbing background questions include: <ul style="list-style-type: none"> <li>• Are blueprints of the building available?</li> <li>• Are there known plumbing "dead-ends", low use areas, existing leaks or other "problem areas"?</li> </ul> Are renovations planned for any of the plumbing system?	Not all prints are available No dead end low use areas All leaks were identified during walk through and have been repaired No plumbing system renovations planned

Questions		Answers
<b>Walk-Through</b> <i>These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.</i>		
1. Confirm the material of Service Line visually.	Duct iron	
2. Confirm the presence of POE or POU treatment.	No POE or POU treatment	
3. What are the potable water pipes made of in your facility? <ul style="list-style-type: none"> <li>• Lead</li> <li>• Plastic</li> <li>• Galvanized Metal</li> <li>• Cast Iron</li> <li>• Copper</li> <li>• Other</li> </ul> <p>Note the water flow through the building and the areas that receive water first, and which areas receive water last.</p>	Copper Galvanized metal Brass  Water flow through the building shown on the prints	
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N	No  No electrical wires grounded to water pipes
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes See Attachment C	
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory. See Attachment C	

Questions	Answers	
<p>7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit?</p> <p>Recalled Drinking Water Fountains</p> <p>Make and Model</p>	<p>Y / N YES, all water coolers have been checked and compared to the list of recalled water coolers</p>	
<p>8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected?</p> <p>Note the locations of water outlets.</p>	<p>None on the list of recalled water coolers</p> <p>Type</p> <p>Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory.</p>	
<p>9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily?</p>	<p>Y / N</p> <p>Complete "Operational Column" in Attachment C- Drinking Water Outlet Inventory.</p> <p>Type/ Location</p> <p>Description</p>	
<p>Permanently</p> <p>Temporarily</p>		

## Attachment C – Drinking Water Outlet Inventory

Name of School: Henry Harris Community School

Address: 135 Avenue C, Bayonne, New Jersey 07002

Grade Levels: Elementary School Year School Constructed: Unknown Renovated/Additions: NA

Individual School Project Officer: Scott Nolan

Date Completed: 09/30/22

# <sup>1</sup>	Type	Location	Code	Operational <sup>2</sup> (Y/N)	Signs of Corrosion <sup>3</sup> (Y/N)	Filter <sup>4</sup> (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Water Fountain	Right Bubbler by Room 102	HH-01	Y	Y	N	Y	N	N	N	NA	NA	
02	Water Fountain	Right Bubbler by Room 102	HH-02	Y	Y	N	Y	N	N	N	NA	NA	Flush
03	Water Fountain	Left Bubbler by Room 102	HH-03	Y	Y	Y	Y	N	N	N	NA	NA	
04	Water Fountain	Bubbler by Principal's Office	HH-04	Y	N	N	N	N	N	N	NA	NA	
05	Sink	Main Office Faucet	HH-05	Y	N	Y	Y	Y	N	N	NA	NA	
06	Sink	Bathroom Sink, Left Side	HH-06	Y	N	N	N	Y	N	N	NA	NA	

<sup>1</sup> Number outlets starting at the closest outlet to the Point of Entry (POE).

<sup>2</sup> Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

<sup>3</sup> Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

<sup>4</sup> Document on Attachment D- Filter Inventory.

07	Sink	Bathroom Sink, Right Side	HH-07	Y	N	N	N	Y	N	N	NA	NA	
08	Sink	Lunchroom Faucet	HH-08	Y	N	N	N	N	N	N	NA	NA	
09	Water Fountain	Left Bubbler by Lunchroom	HH-09	Y	N	N	N	N	N	N	NA	NA	
10	Water Fountain	Right Bubbler by Lunchroom	HH-10	Y	N	N	N	N	N	N	NA	NA	
11	Sink	Pre-K Room 108 Sink	HH-11	Y	N	N	N	Y	N	N	NA	NA	
12	Sink	Pre-K Room 108 Bathroom Sink	HH-12	Y	N	Y	N	Y	N	N	NA	NA	
13	Sink	Pre-K Room 107 Sink	HH-13	Y	N	N	N	Y	N	N	NA	NA	
14	Sink	Pre-K 107 Bathroom Sink	HH-14	Y	N	Y	N	Y	N	N	NA	NA	
15	Sink	Pre-K Room 106 Bathroom Sink	HH-15	Y	N	Y	N	Y	N	N	NA	NA	
16	Water Fountain	Left Bubbler by Room 201	HH-16	Y	N	Y	N	N	N	N	NA	NA	
17	Water Fountain	Right Bubbler by Room 201	HH-17	Y	N	Y	N	N	N	N	NA	NA	
18	Sink	Library Faucet	HH-18	Y	N	Y	N	Y	N	N	NA	NA	
19	Sink	Faculty Room Faucet	HH-19	Y	N	Y	N	Y	N	N	NA	NA	
20	Water Fountain	Bubbler Across from Nurse's Office	HH-20	Y	N	Y	N	N	N	N	NA	NA	
21	Sink	Nurse's Office Faucet	HH-21	Y	N	Y	N	Y	N	N	NA	NA	
22	Water Fountain	Bubbler by Room 21	HH-22	Y	N	Y	N	N	N	N	NA	NA	
23	Water Fountain	Left Bubbler by Room 20	HH-23	Y	N	Y	N	N	N	N	NA	NA	
24	Water	Right Bubbler	HH-24	Y	N	Y	N	N	N	N	NA	NA	

	Fountain	by Room 20											
25	Water Fountain	Copy Room Bubbler	HH-25	Y	N	N	N	N	N	N	NA	NA	
26	Sink	Copy Room Sink	HH-26	Y	N	N	N	Y	N	N	NA	NA	
27	Water Fountain	Bubbler by 302, Left Side	HH-27	Y	N	Y	N	N	N	N	NA	NA	
28	Water Fountain	Bubbler by 302, Right Side	HH-28	Y	Y	N	N	N	N	N	NA	NA	
29	Water Fountain	Bubbler Across Room 37	HH-29	Y	N	Y	N	N	N	N	NA	NA	
30	Water Fountain	Bubbler by Room 31, Left Side	HH-30	Y	N	Y	N	N	N	N	NA	NA	
31	Water Fountain	Bubbler by Room 31, Right Side	HH-31	Y	N	Y	N	N	N	N	NA	NA	
32	Chiller	Chiller by Room 306	HH-32	Y	N	Y	N	N	N	N	NA	NA	
33	Water Fountain	Bubbler Between 306 and 307	HH-33	Y	N	Y	N	N	N	N	NA	NA	
34	Water Fountain	Sink Between 306 and 307	HH-34	Y	N	N	N	Y	N	N	NA	NA	

<sup>1</sup> Number outlets starting at the closest outlet to the Point of Entry (POE).

<sup>1</sup> Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

<sup>1</sup> Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

<sup>1</sup> Document on Attachment D- Filter Inventory.

## Attachment D - Filter Inventory

Name of School: Henry Harris Community School      Grade Levels: Elementary School

Address: 135 Avenue C, Bayonne, New Jersey 07002

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
HH-01	American Standard	N/A	N/A	N/A	N/A
HH-02	American Standard	N/A	N/A	N/A	N/A
HH-03	Halsey T.	N/A	1935	N/A	N/A
HH-04	N/A	N/A	N/A	N/A	N/A
HH-05	3M	N/A	N/A	N/A	N/A
HH-06	N/A	N/A	N/A	N/A	N/A
HH-07	N/A	N/A	N/A	N/A	N/A
HH-08	N/A	N/A	N/A	N/A	N/A
HH-09	Halsey T.	N/A	1935	N/A	N/A
HH-10	Halsey T.	N/A	1935	N/A	N/A
HH-11	N/A	N/A	N/A	N/A	N/A
HH-12	Gerber	N/A	N/A	N/A	N/A
HH-13	N/A	N/A	N/A	N/A	N/A
HH-14	Gerber	N/A	N/A	N/A	N/A
HH-15	American Standard	N/A	N/A	N/A	N/A
HH-16	American Standard	N/A	1935	N/A	N/A
HH-17	American Standard	N/A	1935	N/A	N/A
HH-18	Delta	N/A	N/A	N/A	N/A
HH-19	Elkay	N/A	N/A	N/A	N/A
HH-20	Halsey T.	N/A	1935	N/A	N/A
HH-21	American Plumber	W835-PR	N/A	N/A	N/A
HH-22	Halsey T.	N/A	1935	N/A	N/A
HH-23	Halsey T.	N/A	1935	N/A	N/A

HH-24	American Standard	N/A	N/A	N/A	N/A
HH-25	N/A	N/A	N/A	N/A	N/A
HH-26	N/A	N/A	N/A	N/A	N/A
HH-27	Elkay	N/A	N/A	N/A	N/A
HH-28	American Standard	N/A	N/A	N/A	N/A
HH-29	Halsey T.	N/A	1935	N/A	N/A
HH-30	American Standard	N/A	N/A	N/A	N/A
HH-31	American Standard	N/A	N/A	N/A	N/A
HH-32	Halsey T.	HAC8FSCQ1E	N/A	N/A	N/A
HH-33	N/A	N/A	N/A	N/A	N/A
HH-34	N/A	N/A	N/A	N/A	N/A



## Attachment E – Flushing Log

Name of School: Henry Harris Community SchoolAddress: 135 Avenue C, Bayonne, New Jersey 07002Grade Levels: Elementary SchoolIndividual School Project Officer: Scott NolanDate: 09/30/2022

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Right Bubbler by Room 102	HH-01	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Right Bubbler by Room 102	HH-02	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Left Bubbler by Room 102	HH-03	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Principal's Office	HH-04	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Main Office Faucet	HH-05	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bathroom Sink, Left Side	HH-06	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bathroom Sink, Right Side	HH-07	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Lunchroom Faucet	HH-08	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Left Bubbler by Lunchroom	HH-09	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Right Bubbler by Lunchroom	HH-10	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 108 Sink	HH-11	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 108 Bathroom Sink	HH-12	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 107 Sink	HH-13	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K 107 Bathroom Sink	HH-14	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 106 Bathroom Sink	HH-15	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Left Bubbler by Room 201	HH-16	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Right Bubbler by Room 201	HH-17	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Library Faucet	HH-18	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Faculty Room Faucet	HH-19	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Nurse's Office	HH-20	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling

Nurse's Office Faucet	HH-21	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 21	HH-22	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Left Bubbler by Room 20	HH-23	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Right Bubbler by Room 20	HH-24	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Copy Room Bubbler	HH-25	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Copy Room Sink	HH-26	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by 302, Left Side	HH-27	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by 302, Right Side	HH-28	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across Room 37	HH-29	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 31, Left Side	HH-30	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 31, Right Side	HH-31	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Room 306	HH-32	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Between 306 and 307	HH-33	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Sink Between 306 and 307	HH-34	September 30, 2022	5:30 pm	2-3 Minutes	Water Sampling

**Attachment F - Pre – Sampling Water Use Certification**


TO BE COMPLETED BY THE BAYONNE BOE DISTRICT REPRESENTATIVE:		
School Name: <u>Henry Harris Community</u> <u>School</u>		
Sample collection address:	<u>135 Avenue C,</u> <u>Bayonne, New Jersey 07002</u>	
Water was last used:	<u>Time: 5:30 pm</u>	<u>Date: September 30, 2022</u>
Sample commencement:	<u>Time: 8:10 am</u>	<u>Date: September 31, 2022</u>
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Scott Nolan	09/30/2022	
Signature	Date	

**DO NOT DRINK**



**SAFE FOR HANDWASHING**



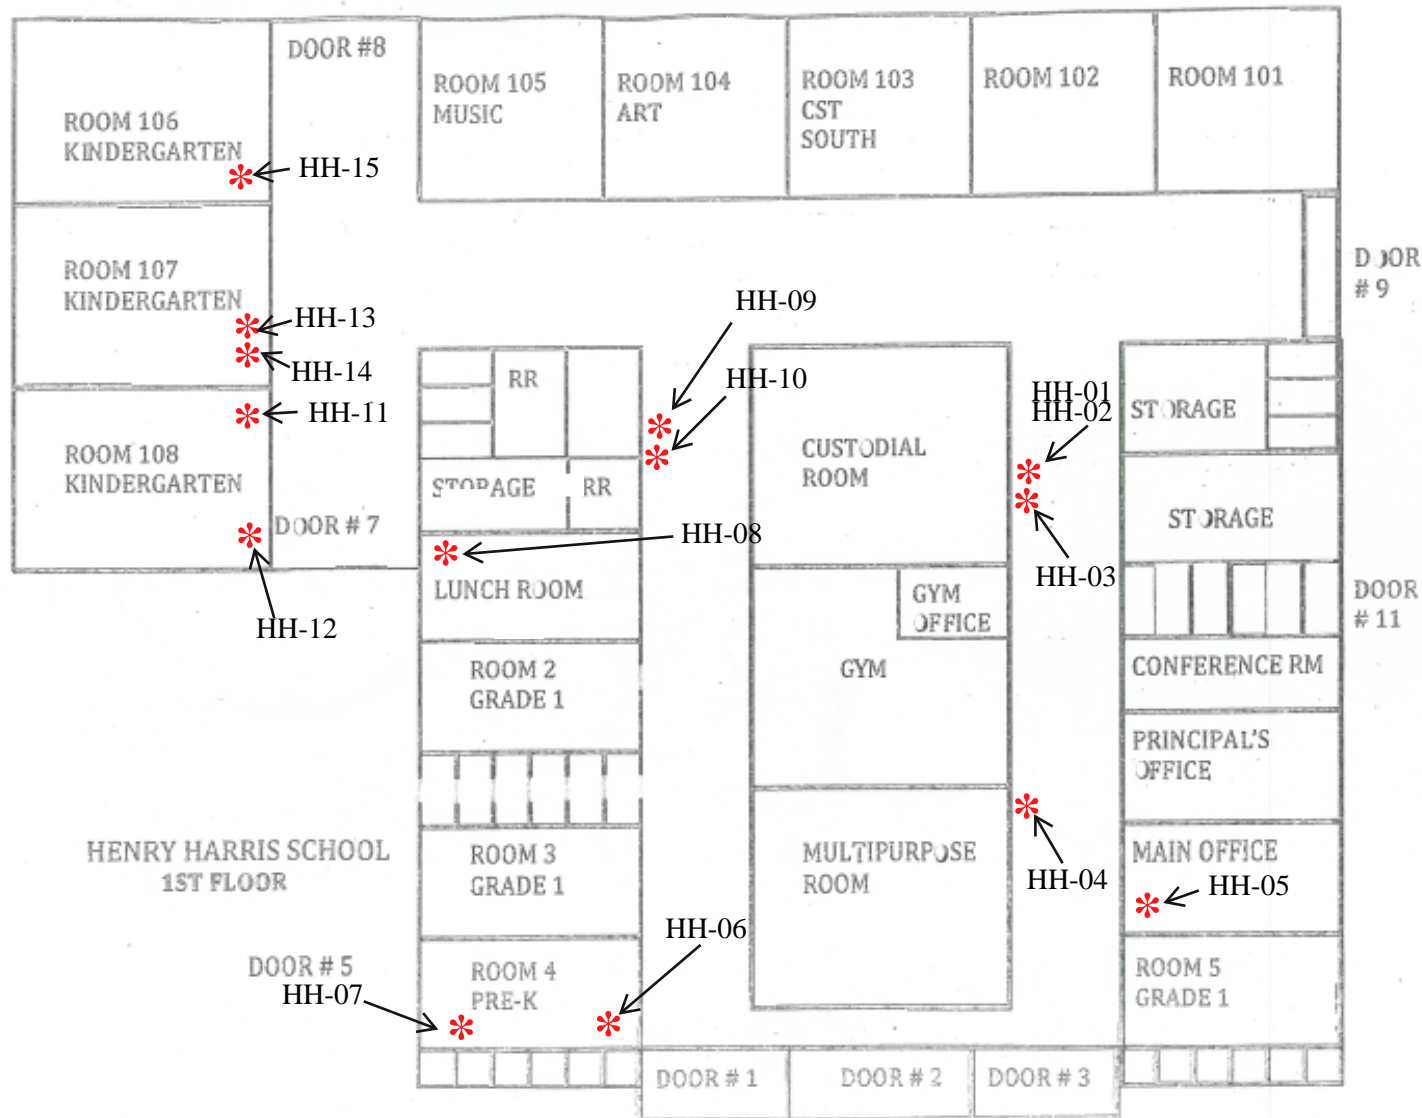

**Key:**  
 \* = Drinking Water Sampling Location



464 Valley Brook Avenue, Lyndhurst NJ 07071  
 129 Sea Girt Avenue, Manasquan NJ 08736  
 Phone: (800) 423-0766 • Fax: (201) 438-1798  
 www.mccabeenv.com


Project:  
 Bayonne Bayonne Board of  
 Education Henry Harris  
 Community School Lead in  
 Drinking Water

Drawing Title:  
 Henry Harris Community School  
 First Floor Sample Locations


Note:  
 Not To Scale

MES Project Number: 22-04448

Date:  
 09/07/2022

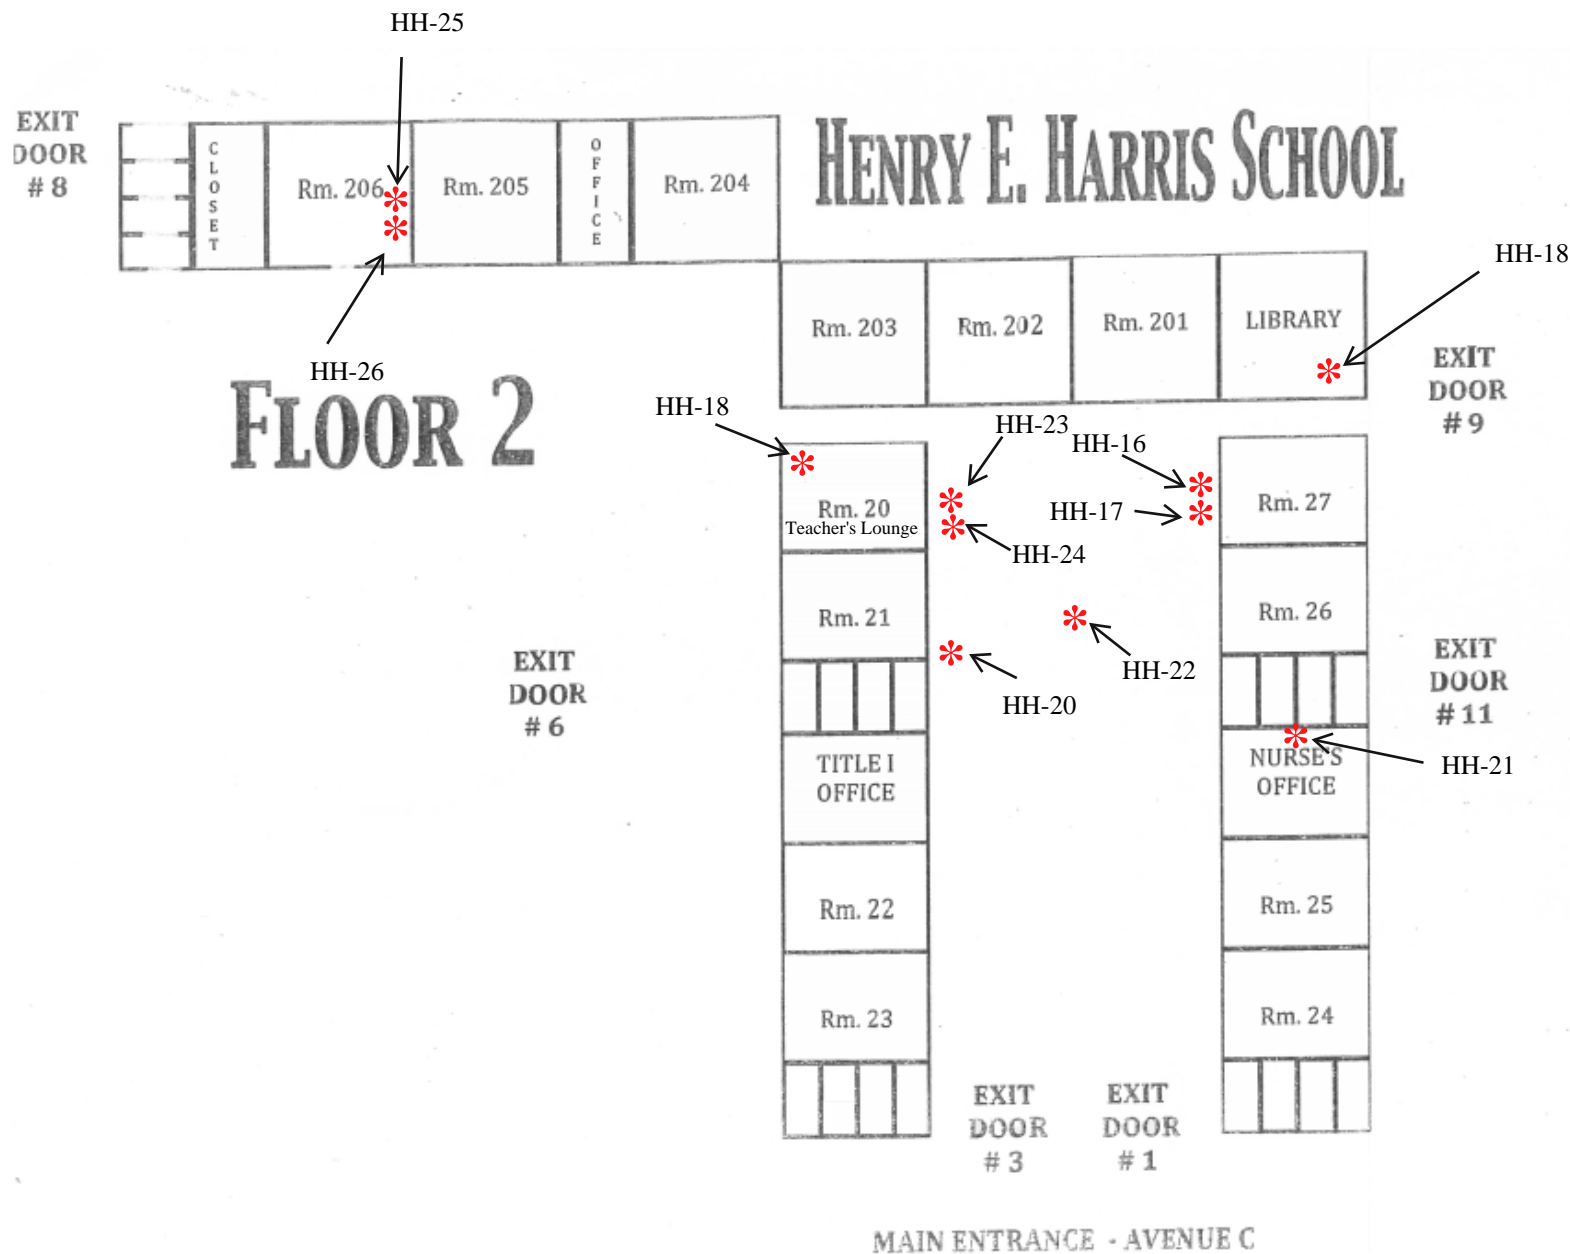


EXIT  
DOOR  
# 8

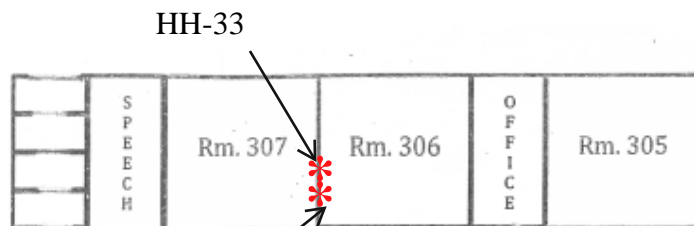


# FLOOR 3

EXIT  
DOOR  
# 6

## HENRY E. HARRIS SCHOOL

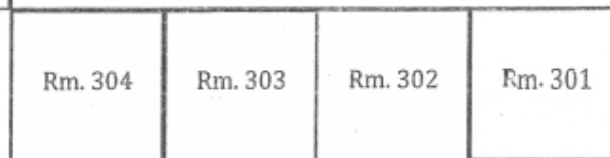

EXIT  
DOOR  
# 9

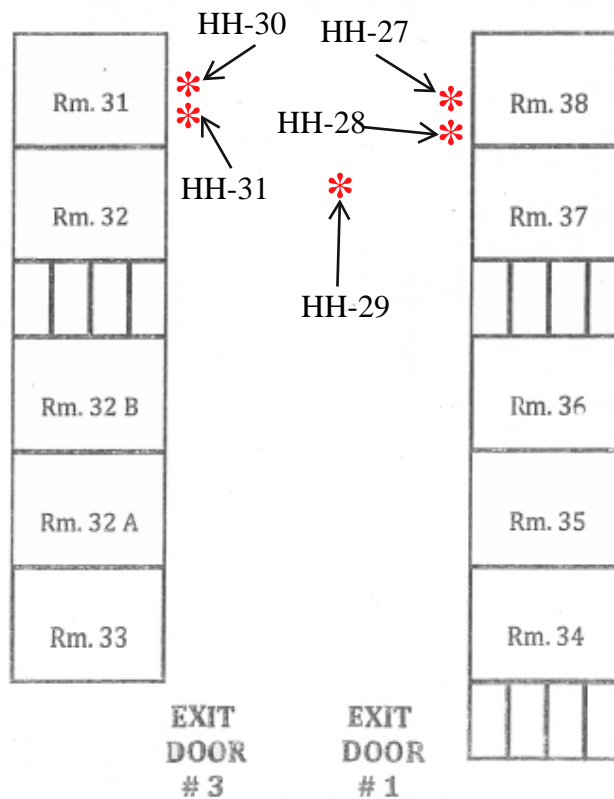

EXIT  
DOOR  
# 11

MAIN ENTRANCE - AVENUE C

**Key:**  
\* = Drinking Water Sampling Location



**McCABE**  
ENVIRONMENTAL SERVICES LLC

464 Valley Brook Avenue, Lyndhurst NJ 07071  
129 Sea Girt Avenue, Manasquan NJ 08736  
Phone: (800) 423-0766 • Fax: (201) 438-1798  
www.mccabeenv.com

Project:  
Bayonne Bayonne Board of  
Education Henry Harris  
Community School Lead in  
Drinking Water

Drawing Title:  
Henry E. Harris Community School  
Third Floor Sample Locations

Note:  
Not To Scale

MES Project Number: 22-04448

Date:  
09/07/2022