



464 Valley Brook Avenue, Lyndhurst NJ 07071  
129 Sea Girt Avenue, Manasquan NJ 08736  
Phone: (800) 423-0766 • Fax: (201) 438-1798  
[www.mccabeenv.com](http://www.mccabeenv.com)

---

## LEAD IN DRINKING WATER TESTING REPORT

*Conducted for:*

Bayonne Board of Education  
669 Avenue A  
Bayonne, New Jersey 07002

*Conducted at:*

Mary J. Donohoe Elementary School  
25 E 5<sup>th</sup> Street  
Bayonne, New Jersey 07002

*Submitted by:*

McCabe Environmental Services, L.L.C.  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

**REPORT DATE:** October 25, 2022

**MES PROJECT NO.:** 22-04448

*Prepared by:*

A handwritten signature in blue ink, appearing to read 'Gary Clare'.

**Gary Clare**  
**Project Manager**

*Signed for the Company by:*

A handwritten signature in blue ink, appearing to read 'John H. Chiaviello'.

**John H. Chiaviello**  
**Vice President**

## **TABLE OF CONTENTS**

	<b><u>Page</u></b>
1.0 INTRODUCTION .....	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS .....	2
5.0 DISCUSSION AND CONCLUSION .....	3

### **APPENDIX A**

Laboratory Certificates of Analysis  
&  
Sample Chain of Custody Forms

### **APPENDIX B**

School District Sampling Attachments

## **1.0     INTRODUCTION**

McCabe Environmental Services, L.L.C. (McCabe) was retained by Bayonne Board of Education (Client) to conduct lead in drinking water testing at Mary J. Donohoe Elementary School located at 25 E 5<sup>th</sup> Street, Bayonne, New Jersey 07002.

The project information is as follows:

<u>Client Name:</u>	Bayonne Board of Education
<u>Contact Person:</u>	Mr. Daniel Castles
<u>Project Name:</u>	Mary J. Donohoe – Lead in Drinking Water Testing
<u>Project Location:</u>	25 E 5 <sup>th</sup> Street Bayonne, New Jersey 07002
<u>Date(s) of Service:</u>	August 31, 2022
<u>McCabe Personnel:</u>	Gary Clare, Gerard D'Alessio & Brandon Soto

## **2.0     SCOPE OF WORK**

Drinking water testing was performed at Mary J. Donohoe Elementary School on August 31, 2022. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead concentrations. Samples were collected from various potential drinking water outlets located throughout the building. Testing was followed as per past reports provided by Bayonne Board of Education. Locations were also added in certain schools as per Scott Nolan's request.

## **3.0     PROCEDURES**

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected closest to where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards.

#### 4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
MJ-01	First Draw – 1 <sup>st</sup> Floor Pre-K Bathroom Sink	1.7	Pass	Pass
MJ-02	30 Second Flush – 1 <sup>st</sup> Floor Pre-K Bathroom Sink	7	Pass	Pass
<b>MJ-03</b>	<b>First Draw – Bubbler by Room 5A</b>	<b>17.8</b>	<b>Fail</b>	<b>Pass</b>
MJ-04	First Draw – Pre-K HR3 Bathroom Sink – Left	11.1	Pass	Pass
MJ-05	First Draw – Pre-K HR3 Bathroom Sink – Right	5.9	Pass	Pass
MJ-06	First Draw – Bottle Filler by Principal Office	<0.5	Pass	Pass
MJ-07	First Draw – Food Storage Sink	8.1	Pass	Pass
MJ-08	First Draw – Chiller by Pre-K Room 1	<0.5	Pass	Pass
MJ-09	First Draw – Pre-K Room 1 – Sink	1.1	Pass	Pass
MJ-10	First Draw – Pre-K Room 1 Bathroom Sink	1	Pass	Pass
MJ-11	First Draw – Pre-K Room 2 – Sink	1.5	Pass	Pass
MJ-12	First Draw – Pre-K Room 2 Bathroom Sink	0.9	Pass	Pass
<b>MJ-13</b>	<b>First Draw – Bubbler by Room 11B</b>	<b>19</b>	<b>Fail</b>	<b>Pass</b>
MJ-14	First Draw – Bottle Filler by Room 6B	<0.5	Pass	Pass
MJ-15	First Draw – Nurse’s Office Sink	2.2	Pass	Pass
MJ-16	First Draw – Teacher’s Room Faucet	<0.5	Pass	Pass
MJ-17	First Draw – Bubbler by Room 19C	9.8	Pass	Pass
MJ-18	First Draw – Bottle Filler by Room 13C	<0.5	Pass	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
MJ-19	First Draw – Chiller by Music Room	<0.5	Pass	Pass
MJ-20	First Draw – Professional Development Room Bubbler	<0.5	Pass	Pass
MJ-21	First Draw – Professional Development Room Faucet	0.5	Pass	Pass
MJ-22	First Draw – Music Room Bubbler	<0.5	Pass	Pass
MJ-23	First Draw – Music Room Faucet	0.8	Pass	Pass
MJ-24	First Draw – Art Room Bubbler	<0.5	Pass	Pass
MJ-25	First Draw – Art Room Faucet	2.6	Pass	Pass

## **5.0      DISCUSSION AND CONCLUSION**

A total of twenty-five (25) samples were collected from Mary J. Donohoe Elementary School located at 25 E 5th Street, Bayonne, New Jersey 07002. Two (2) samples were found to be greater than the EPA Lead and Copper Rule standard of 15 ppb. All other samples were found to be less than the EPA standards of 20 ppb and 15 ppb.

McCabe recommends discontinued usage of the outlets which resulted in failed results until additional samples can be collected and analyzed and a permanent solution can be recommended.

- **Bubbler by Room 5A**
- **Bubbler by Room 11B**

Proper signage shall be posted at these locations identifying “Do Not Drink, Safe For Washing Hands.” This sign can be found in Appendix B.

To address the water quality in the short term, McCabe recommends that it may be appropriate to inspect piping near these fixtures to determine if any corrosion is evident and whether it is possible to replace portions of the piping.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building’s plumbing is not having an adverse impact on water quality.

**APPENDIX A**

**LABORATORY CERTIFICATES OF ANALYSIS  
&  
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, September 12, 2022

Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
SDG ID: GCM21461  
Sample ID#s: CM21461 - CM21485

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301  
CT Lab Registration #PH-0618  
MA Lab Registration #M-CT007  
ME Lab Registration #CT-007  
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003  
NY Lab Registration #11301  
PA Lab Registration #68-03530  
RI Lab Registration #63  
VT Lab Registration #VT11301



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21461

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
MJ-11	CM21461	DRINKING WATER
MJ-12	CM21462	DRINKING WATER
MJ-13	CM21463	DRINKING WATER
MJ-14	CM21464	DRINKING WATER
MJ-15	CM21465	DRINKING WATER
MJ-16	CM21466	DRINKING WATER
MJ-17	CM21467	DRINKING WATER
MJ-18	CM21468	DRINKING WATER
MJ-19	CM21469	DRINKING WATER
MJ-20	CM21470	DRINKING WATER
MJ-01	CM21471	DRINKING WATER
MJ-02	CM21472	DRINKING WATER
MJ-03	CM21473	DRINKING WATER
MJ-04	CM21474	DRINKING WATER
MJ-05	CM21475	DRINKING WATER
MJ-06	CM21476	DRINKING WATER
MJ-07	CM21477	DRINKING WATER
MJ-08	CM21478	DRINKING WATER
MJ-09	CM21479	DRINKING WATER
MJ-10	CM21480	DRINKING WATER
MJ-21	CM21481	DRINKING WATER
MJ-22	CM21482	DRINKING WATER
MJ-23	CM21483	DRINKING WATER
MJ-24	CM21484	DRINKING WATER
MJ-25	CM21485	DRINKING WATER





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:46  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21461

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:48  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21462

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:50  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21463

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	19	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:52  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21464

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-14

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:53  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21465

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-15

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.2	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:55  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21466

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-16

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:57  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21467

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-17

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	9.8	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

8:59  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21468

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-18

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:01  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21469

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-19

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:04  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21470

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-20

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:06  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21471

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:07  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21472

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	7	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:15  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21473

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	17.8	0.5	2	ppb	15			09/09/22	CPP	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:16  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21474

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	11.1	0.5	2	ppb	15			09/09/22	CPP	E200.8
Total Metal Digestion	Completed							09/05/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:18  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21475

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	5.9	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:20  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21476

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:25  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21477

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	8.1	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:29  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21478

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:30  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21479

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.1	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:32  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21480

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:34  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21481

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-21

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.5	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:35  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21482

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-22

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:36  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21483

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-23

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:38  
18:30

### Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21484

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-24

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager





Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071

### Sample Information

Matrix: DRINKING WATER  
Location Code: MCCABE-PB  
Rush Request: Standard  
P.O.#:

### Custody Information

Collected by: GD  
Received by: CP  
Analyzed by: see "By" below

### Date

08/31/22  
09/01/22

### Time

9:39  
18:30

## Laboratory Data

SDG ID: GCM21461  
Phoenix ID: CM21485

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION  
Client ID: MJ-25

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.6	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected  
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)  
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

### Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.  
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager

# Analysis Report - Summary

September 12, 2022

Attn: Jarred Panecki  
McCabe Environmental Services, LLC  
464 Valley Brook Avenue  
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCM21461



Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
Project: 22-04448 Bayonne Board Of Education								
CM21461	MJ-11	08/31/22	Lead	1.5	0.5	ppb	09/09/22	E200.8
CM21462	MJ-12	08/31/22	Lead	0.9	0.5	ppb	09/09/22	E200.8
CM21463	MJ-13	08/31/22	Lead	19	0.5	ppb	09/09/22	E200.8
CM21464	MJ-14	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21465	MJ-15	08/31/22	Lead	2.2	0.5	ppb	09/09/22	E200.8
CM21466	MJ-16	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21467	MJ-17	08/31/22	Lead	9.8	0.5	ppb	09/09/22	E200.8
CM21468	MJ-18	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21469	MJ-19	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21470	MJ-20	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21471	MJ-01	08/31/22	Lead	1.7	0.5	ppb	09/09/22	E200.8
CM21472	MJ-02	08/31/22	Lead	7	0.5	ppb	09/09/22	E200.8
CM21473	MJ-03	08/31/22	Lead	17.8	0.5	ppb	09/09/22	E200.8
CM21474	MJ-04	08/31/22	Lead	11.1	0.5	ppb	09/09/22	E200.8
CM21475	MJ-05	08/31/22	Lead	5.9	0.5	ppb	09/09/22	E200.8
CM21476	MJ-06	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21477	MJ-07	08/31/22	Lead	8.1	0.5	ppb	09/09/22	E200.8
CM21478	MJ-08	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21479	MJ-09	08/31/22	Lead	1.1	0.5	ppb	09/09/22	E200.8
CM21480	MJ-10	08/31/22	Lead	1	0.5	ppb	09/09/22	E200.8
CM21481	MJ-21	08/31/22	Lead	0.5	0.5	ppb	09/09/22	E200.8
CM21482	MJ-22	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21483	MJ-23	08/31/22	Lead	0.8	0.5	ppb	09/09/22	E200.8
CM21484	MJ-24	08/31/22	Lead	< 0.5	0.5	ppb	09/09/22	E200.8
CM21485	MJ-25	08/31/22	Lead	2.6	0.5	ppb	09/09/22	E200.8

Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
--------	-----------	-------------	-----------	--------	----	-------	------------------	-----------

---

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit



Phyllis Shiller  
Laboratory Director  
September 12, 2022



Environmental Laboratories, Inc.  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## QA/QC Report

September 12, 2022

### QA/QC Data

SDG I.D.: GCM21461

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 640617 (mg/L), QC Sample No: CM21455 2X (CM21461, CM21462, CM21463, CM21464)

#### ICP MS Metals - Aqueous

Lead	BRL	0.0001	0.0253	0.0256	1.20	103						96.6	
------	-----	--------	--------	--------	------	-----	--	--	--	--	--	------	--

QA/QC Batch 640617A (mg/L), QC Sample No: CM21465 2X (CM21465, CM21466, CM21467, CM21468, CM21469, CM21470, CM21471, CM21472, CM21473, CM21474)

#### ICP MS Metals - Aqueous

Lead	BRL	0.0001				103						97.2	
------	-----	--------	--	--	--	-----	--	--	--	--	--	------	--

Comment:

This batch does not include a duplicate.

QA/QC Batch 640735 (mg/L), QC Sample No: CM21475 2X (CM21475, CM21476, CM21477, CM21478, CM21479, CM21480, CM21481, CM21482, CM21483, CM21484)

#### ICP MS Metals - Aqueous

Lead	BRL	0.0001	0.0059	0.0059	0	105						97.8	
------	-----	--------	--------	--------	---	-----	--	--	--	--	--	------	--

QA/QC Batch 640735A (mg/L), QC Sample No: CM21485 2X (CM21485)

#### ICP MS Metals - Aqueous

Lead	BRL	0.0001				105						98.0	
------	-----	--------	--	--	--	-----	--	--	--	--	--	------	--

Comment:

This batch does not include a duplicate.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

RPD - Relative Percent Difference

LCS - Laboratory Control Sample

LCSD - Laboratory Control Sample Duplicate

MS - Matrix Spike

MS Dup - Matrix Spike Duplicate

NC - No Criteria

Intf - Interference

Phyllis Shiller, Laboratory Director  
September 12, 2022

Monday, September 12, 2022

Criteria: NJ: DW

State: NJ

## Sample Criteria Exceedances Report

### GCM21461 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
CM21463	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	19	0.5	15	1	ppb
CM21473	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	17.8	0.5	15	1	ppb

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



**Environmental Laboratories, Inc.**  
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045  
Tel. (860) 645-1102 Fax (860) 645-0823



## Analysis Comments

September 12, 2022

SDG I.D.: GCM21461

---

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

# McCabe Environmental Services, L.L.C.

464 VALLEY BROOK AVENUE LYNDBURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

2.50L WUP

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Mary J. Donohoe Community School 25 E 5th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 08/31/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	MJ-11	First draw - Prek Room 2 Sink	0906	LEAD - 200.8
DW	MJ-12	First draw - Prek Room 2 Bathroom Sink	0907	LEAD - 200.8
DW	MJ-13	First draw - Bubble by Room 11B	0915	LEAD - 200.8
DW	MJ-14	First draw - Bottle filler by Room 6B	0916	LEAD - 200.8
DW	MJ-15	First draw - Nurse's office Sink	0918	LEAD - 200.8
DW	MJ-16	First draw - Teacher's Room Faucet	0920	LEAD - 200.8
DW	MJ-17	First draw - Bubble by Room 19C	0925	LEAD - 200.8
DW	MJ-18	First draw - Bottle filler by Room 13C	0929	LEAD - 200.8
DW	MJ-19	First draw - Chiller by music Room	0930	LEAD - 200.8
DW	MJ-20	First draw - Botles Signa developm ex Room Bubblet	0932	LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Date:	Time:	Received by: (Print) [Signature]	Date:	Time:
Signature: [Signature]			Signature: [Signature]		
Relinquished by (Print) [Signature]	Date:	Time:	Received by: (Print)	Date:	Time:
Signature: [Signature]			Signature: Emily SA	9/1/22	1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

# McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue, Lyndhurst, NJ 07071 • Phone: (201) 438-4839 FAX: (201) 438-1798

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Mary J. Donohoe Community School 25 E 5th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard DAlessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448		SAMPLE DATE: 08/31/22	

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	MJ-01	First draw - 1st Floor Prek Bathroom sink	0846	LEAD - 200.8
DW	MJ-02	30 second Flush - 1st Floor Prek Bathroom sink	0848	LEAD - 200.8
DW	MJ-03	First draw - Bubble by Reservoir Room 5A	0850	LEAD - 200.8
DW	MJ-04	First draw - Prek HR3 Bathroom sink - Left	0852	LEAD - 200.8
DW	MJ-05	First draw - Prek - HR3 Bathroom sink - Right	0853	LEAD - 200.8
DW	MJ-06	First draw - Bottle filler by Principal office	0855	LEAD - 200.8
DW	MJ-07	First draw - Food storage sink	0857	LEAD - 200.8
DW	MJ-08	First draw - Chiller by Prek Room 1	0859	LEAD - 200.8
DW	MJ-09	First draw Prek Room 1 sink	0901	LEAD - 200.8
DW	MJ-10	First draw Prek Room 1 Bathroom sink	0904	LEAD - 200.8

Relinquished by (Print) Gerard DAlessio	Date:	Time:
Signature: <i>Gerard DAlessio</i>	Received by: (Print) <i>Keating Carter</i>	9/1/22 206
	Signature: <i>Keating Carter</i>	
Relinquished by (Print) <i>Keating Carter</i>	Date:	Time:
Signature: <i>Keating Carter</i>	Received by: (Print) <i>Emily At</i>	9/1/22 1830
	Signature: <i>Emily At</i>	

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE



# McCabe Environmental Services, L.L.C.

464 VALLEY BROOK AVENUE LYNDBURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

2.50 w/cip

## LEAD in DRINKING WATER

### CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Mary J. Donohoe Community School 25 E 5th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard DA 10540		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448		SAMPLE DATE: 08/31/22	

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	MJ-21	First draw - Professional development room Faucet	0934	LEAD - 200.8
DW	MJ-22	First draw - <del>Art Room</del> <sup>Music Room</sup> Bubblepr	0935	LEAD - 200.8
DW	MJ-23	First draw - <del>Art Room</del> <sup>Music Room</sup> Sink	0936	LEAD - 200.8
DW	MJ-24	First draw - Art Room Bubblepr	0938	LEAD - 200.8
DW	MJ-25	First draw - Art Room Faucet	0939	LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8

Relinquished by (Print) Gerard DA 10540	Date:	Received by: (Print) Gerard DA 10540	Date:
Signature: [Signature]	Time:	Signature: [Signature]	Time:
Relinquished by (Print) Gerard DA 10540	Date:	Received by: (Print) Gerard DA 10540	Date:
Signature: [Signature]	Time:	Signature: [Signature]	Time:

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

**APPENDIX B**

**SCHOOL DISTRICT SAMPLING  
ATTACHMENTS**

### Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Mary J. Donohoe Community School	08/31/22	Phoenix Environmental Laboratories Inc.	

## Attachment B – Plumbing Profile

**Note:** Complete for each school. For additional information see the USEPA publication, "The 3Ts for Reducing Lead in Drinking Water in Schools"

Name of School: Mary J. Donohoe Community School Grade Levels: K-8

Address: 25 East 5th St., Bayonne, NJ 07002

Individual school project officer Signature: *Scott Nolan* Date: August 2002

Questions	Answers				
<b>Background Information</b>					
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	K-8 Grade School Built in 1900 K-8 Addition was added in 2000				
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Any repairs made after 1986 were done using lead free solder				
3. Where are the most recent plumbing repairs and replacements?	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">Location: 1st floor hallway</td> <td style="width: 50%;">Description: New bottle filler fountain</td> </tr> </table>	Location: 1st floor hallway	Description: New bottle filler fountain		
Location: 1st floor hallway	Description: New bottle filler fountain				
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td colspan="2">Material: Main Building - Duct Iron</td> </tr> <tr> <td colspan="2">Location: The water main (East 5th St) enters the basement/first floor flows through the building to the boiler room where the water meter is located and continues to the remainder of the building</td> </tr> </table>	Material: Main Building - Duct Iron		Location: The water main (East 5th St) enters the basement/first floor flows through the building to the boiler room where the water meter is located and continues to the remainder of the building	
Material: Main Building - Duct Iron					
Location: The water main (East 5th St) enters the basement/first floor flows through the building to the boiler room where the water meter is located and continues to the remainder of the building					
5. Is there point of entry (POE) or point of use (POU) treatment in use?	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">Y / N No treatment of water Type: at POE</td> <td style="width: 50%;">Main Building 1920 Location:</td> </tr> <tr> <td colspan="2">City water comes treated</td> </tr> </table>	Y / N No treatment of water Type: at POE	Main Building 1920 Location:	City water comes treated	
Y / N No treatment of water Type: at POE	Main Building 1920 Location:				
City water comes treated					

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N Yes Building has two 75 gallon hot water storage tank located in the old boiler room Building has a 50 gallon hot water storage tank located in boiler room Building has a 38 gallon hot water heater located 2nd floor storage
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	Yes, Scott Nolan, Andy McCabe, Vinny Caiola, change filters on an as needed basis assign plumbers
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N Yes The district has set-up a routine maintenance program to clean screens
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N NO Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: <ul style="list-style-type: none"> <li>• Name of contaminant(s)</li> <li>• Concentrations found</li> <li>• pH level</li> </ul> Is testing done regularly at the building?	No indoor testing by public water supplier
11. Other plumbing background questions include: <ul style="list-style-type: none"> <li>• Are blueprints of the building available?</li> <li>• Are there known plumbing "dead-ends", low use areas, existing leaks or other "problem areas"?</li> </ul> Are renovations planned for any of the plumbing system?	Not all prints are available No dead-end low use areas All leaks were identified during walk through and have been repaired No plumbing system renovations



Questions	Answers
<b>Walk-Through</b>	
<i>These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.</i>	
1. Confirm the material of Service Line visually.	Duct iron
2. Confirm the presence of POE or POU treatment.	No POE or POU treatment
3. What are the potable water pipes made of in your facility? <ul style="list-style-type: none"><li>• Lead</li><li>• Plastic</li><li>• Galvanized Metal</li><li>• Cast Iron</li><li>• Copper</li><li>• Other</li></ul> Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Cooper Galvanized Metal Brass  Water flow through the building shown on the prints
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N  No  No electrical wires grounded to water pipes
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Location:  Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes Completed in Attachment C - Water Outlet Inventory
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory.

Questions	Answers
<p>7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit?</p> <p>Recalled Drinking Water Fountains</p> <p>Make and Model</p>	<p>Y / N Yes all water coolers have been checked and compared to the list of recalled water coolers</p>
<p>8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected?</p> <p>Note the locations of water outlets.</p>	<p>Type None on the list of recalled water coolers</p>
<p>9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily?</p> <p>Permanently</p> <p>Temporarily</p>	<p>Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory.</p> <p>Y / N</p> <p>Type/ Location</p> <p>Description</p>

## Attachment C – Drinking Water Outlet Inventory

Name of School: Mary J. Donohoe Community School

Address: 25 E 5th Street, Bayonne, New Jersey 07002

Grade Levels: Elementary School

Year School Constructed: Unknown

Renovated/Additions: NA

Individual School Project Officer: Scott Nolan

Date Completed: 09/30/22

# <sup>1</sup>	Type	Location	Code	Operational <sup>2</sup> (Y/N)	Signs of Corrosion <sup>3</sup> (Y/N)	Filter <sup>4</sup> (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Sink	1st Floor Pre-K Bathroom	MJ-01	Y	N	N	N	Y	N	N	NA	NA	
02	Sink	1st Floor Pre-K Bathroom	MJ-02	Y	N	N	N	Y	N	N	NA	NA	Flush
03	Water Fountain	Bubbler by Room 5A	MJ-03	Y	N	Y	N	N	N	N	NA	NA	
04	Sink	Pre-K HR3 Bathroom Sink – Left	MJ-04	Y	N	N	N	Y	N	N	NA	NA	
05	Sink	Pre-K HR3 Bathroom Sink – Right	MJ-05	Y	N	N	N	Y	N	N	NA	NA	

<sup>1</sup> Number outlets starting at the closest outlet to the Point of Entry (POE).

<sup>2</sup> Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

<sup>3</sup> Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

<sup>4</sup> Document on Attachment D- Filter Inventory.



06	Bottle Filling Station	By Principal Office	MJ-06	Y	N	Y	N	N	Y	Y	NA	NA	
07	Sink	Food Storage	MJ-07	Y	N	Y	N	N	N	N	NA	NA	
08	Chiller	Chiller by Pre-K Room 1	MJ-08	Y	N	Y	N	N	N	Y	NA	NA	
09	Sink	Pre-K Room 1 – Sink	MJ-09	Y	N	N	N	Y	N	N	NA	NA	
10	Sink	Pre-K Room 1 Bathroom Sink	MJ-10	Y	N	N	N	Y	N	N	NA	NA	
11	Sink	Pre-K Room 2 – Sink	MJ-11	Y	N	N	N	Y	N	N	NA	NA	
12	Sink	Pre-K Room 2 Bathroom Sink	MJ-12	Y	N	N	N	Y	N	N	NA	NA	
13	Water Fountain	Bubbler by Room 11B	MJ-13	Y	N	N	N	N	N	N	NA	NA	
14	Bottle Filling Station	Bottle Filler by Room 6B	MJ-14	Y	N	Y	N	N	Y	Y	NA	NA	
15	Sink	Nurse's Office	MJ-15	Y	N	N	N	Y	N	N	NA	NA	
16	Sink	Teacher's Room	MJ-16	Y	N	N	N	Y	N	N	NA	NA	
17	Water Fountain	Bubbler by Room 19C	MJ-17	Y	N	Y	N	N	N	N	NA	NA	
18	Bottle Filling Station	By Room 13C	MJ-18	Y	N	Y	N	N	Y	Y	NA	NA	
19	Chiller	Chiller by Music Room	MJ-19	Y	N	Y	N	N	N	Y	NA	NA	
20	Water Fountain	Professional Development Room Bubbler	MJ-20	Y	N	N	N	N	N	N	NA	NA	
21	Sink	Professional Development Room Faucet	MJ-21	Y	N	N	N	Y	N	N	NA	NA	
22	Water Fountain	Music Room Bubbler	MJ-22	Y	N	N	N	N	N	N	NA	NA	
23	Sink	Music Room Faucet	MJ-23	Y	N	N	N	Y	N	N	NA	NA	
24	Water Fountain	Art Room Bubbler	MJ-24	Y	N	N	N	N	N	N	NA	NA	

25	Sink	Art Room Faucet	MJ-25	Y	N	N	N	Y	N	N	NA	NA	
----	------	--------------------	-------	---	---	---	---	---	---	---	----	----	--

<sup>1</sup> Number outlets starting at the closest outlet to the Point of Entry (POE).

<sup>1</sup> Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

<sup>1</sup> Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

<sup>1</sup> Document on Attachment D- Filter Inventory.

## Attachment D - Filter Inventory

Name of School: Mary J. Donohoe Community School

Grade Levels: Elementary School

Address: 25 E 5th Street, Bayonne, New Jersey 07002

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
MJ-01	N/A	N/A	N/A	N/A	N/A
MJ-02	N/A	N/A	N/A	N/A	N/A
MJ-03	Halsey Taylor	N/A	N/A	N/A	N/A
MJ-04	N/A	N/A	N/A	N/A	N/A
MJ-05	N/A	N/A	N/A	N/A	N/A
MJ-06	Elkay	LZWSRSM	N/A	N/A	N/A
MJ-07	American Plumber	W385-PR	N/A	N/A	N/A
MJ-08	Elkay	EBFSA8-1B	N/A	N/A	N/A
MJ-09	N/A	N/A	N/A	N/A	N/A
MJ-10	N/A	N/A	N/A	N/A	N/A
MJ-11	N/A	N/A	N/A	N/A	N/A
MJ-12	N/A	N/A	N/A	N/A	N/A
MJ-13	N/A	N/A	N/A	N/A	N/A
MJ-14	Elkay	LZWRSM	N/A	N/A	N/A
MJ-15	N/A	N/A	N/A	N/A	N/A
MJ-16	N/A	N/A	N/A	N/A	N/A
MJ-17	Elkay	N/A	N/A	N/A	N/A
MJ-18	Elkay	LZWRSM	N/A	N/A	N/A
MJ-19	Elkay	EBFSA8-1D	N/A	N/A	N/A
MJ-20	N/A	N/A	N/A	N/A	N/A
MJ-21	N/A	N/A	N/A	N/A	N/A
MJ-22	N/A	N/A	N/A	N/A	N/A
MJ-23	N/A	N/A	N/A	N/A	N/A
MJ-24	N/A	N/A	N/A	N/A	N/A
MJ-25	N/A	N/A	N/A	N/A	N/A

## Attachment E – Flushing Log

Name of School: Mary J. Donohoe Community School

Address: 25 E 5th Street, Bayonne, New Jersey 07002

Grade Levels: Elementary School

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
1st Floor Pre-K Bathroom Sink	MJ-01	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
1st Floor Pre-K Bathroom Sink	MJ-02	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 5A	MJ-03	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K HR3 Bathroom Sink – Left	MJ-04	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K HR3 Bathroom Sink – Right	MJ-05	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bottle Filler by Principal Office	MJ-06	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Food Storage Sink	MJ-07	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Pre-K Room 1	MJ-08	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 1 – Sink	MJ-09	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 1 Bathroom Sink	MJ-10	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 2 – Sink	MJ-11	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Pre-K Room 2 Bathroom Sink	MJ-12	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 11B	MJ-13	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bottle Filler by Room 6B	MJ-14	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Nurse's Office Sink	MJ-15	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Teacher's Room Faucet	MJ-16	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 19C	MJ-17	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bottle Filler by Room 13C	MJ-18	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Music Room	MJ-19	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Professional Development Room Bubbler	MJ-20	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling

Professional Development Room Faucet	MJ-21	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Music Room Bubbler	MJ-22	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Music Room Faucet	MJ-23	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Art Room Bubbler	MJ-24	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Art Room Faucet	MJ-25	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling

## Attachment F - Pre - Sampling Water Use Certification


TO BE COMPLETED BY THE BAYONNE BOE DISTRICT REPRESENTATIVE:		
School Name:	<u>Mary J. Donohoe Community School</u>	
Sample collection address:	<u>25 E 5th Street, Bayonne, New Jersey 07002</u>	
Water was last used:	<u>Time: 5:30 pm</u>	<u>Date: August 30, 2022</u>
Sample commencement:	<u>Time: 8:46 am</u>	<u>Date: August 31, 2022</u>
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Scott Nolan	<u>09/30/22</u>	
Signature	Date	

**DO NOT DRINK**



**SAFE FOR HANDWASHING**




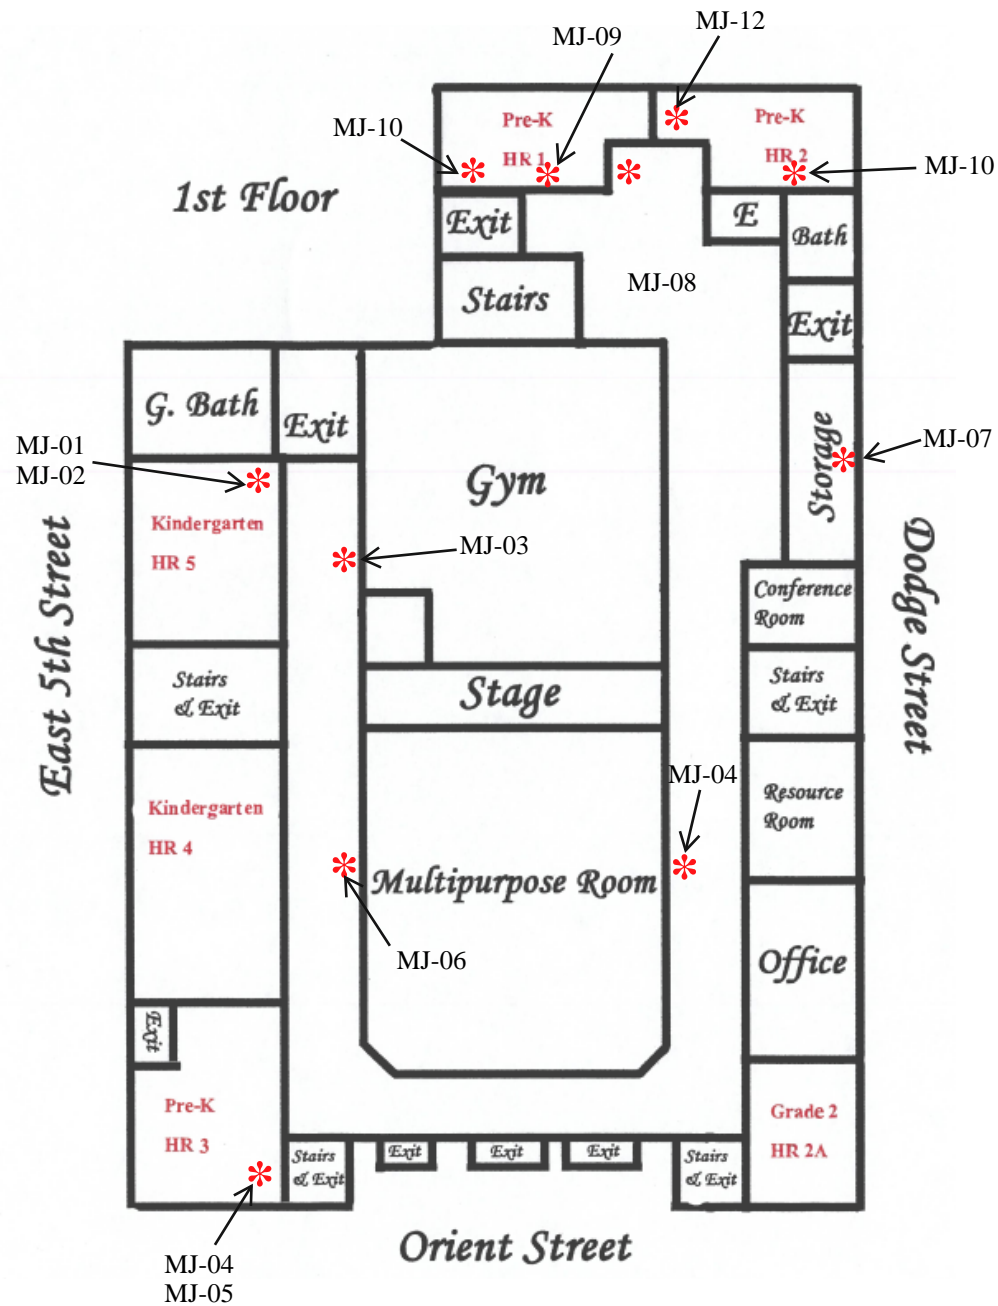

**Key:**


\* = Drinking Water Sampling Location



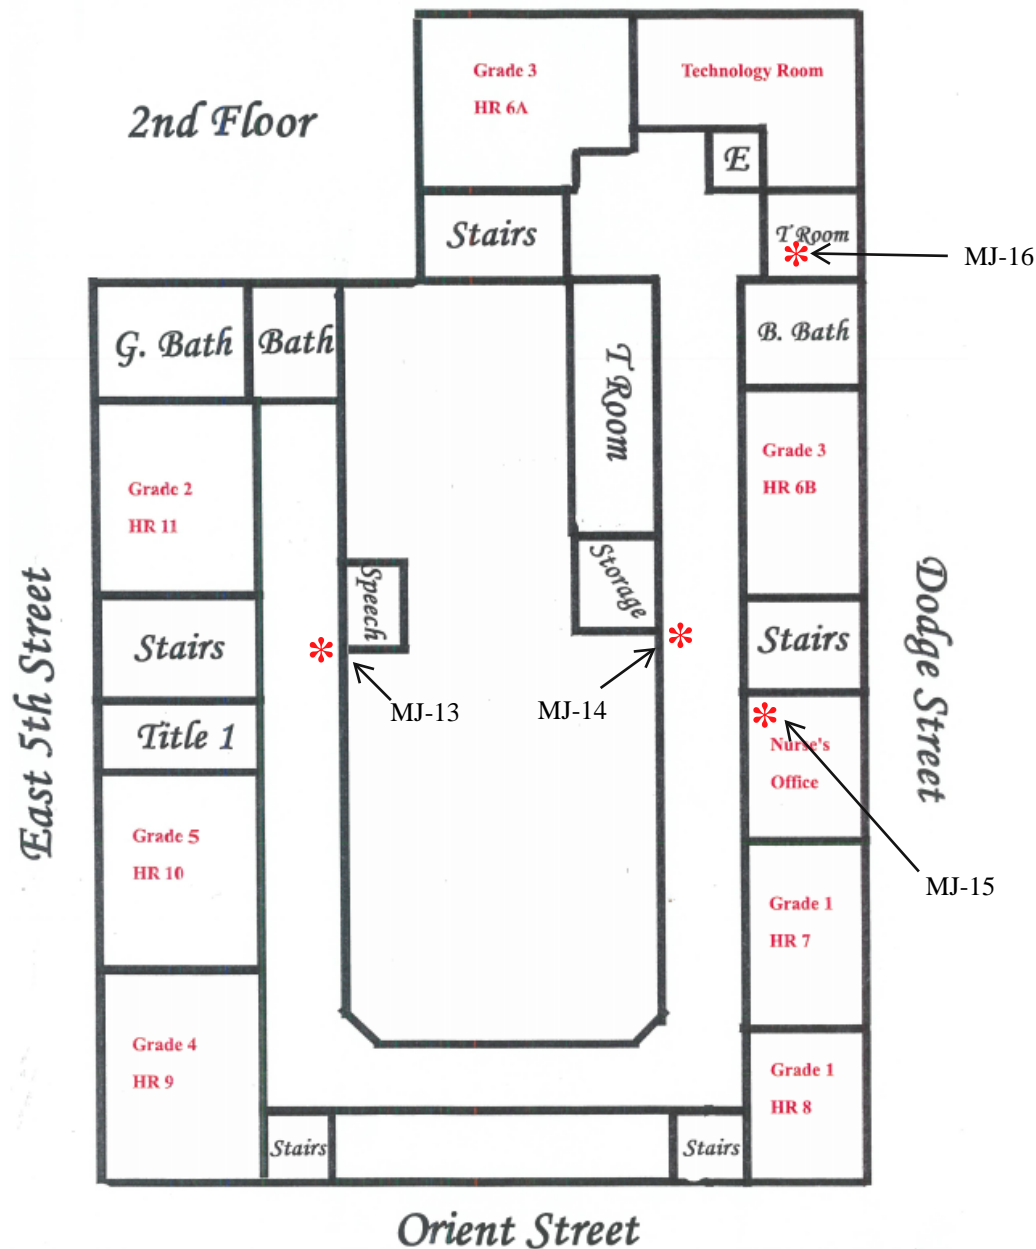

**Key:**

\* = Drinking Water Sampling Location

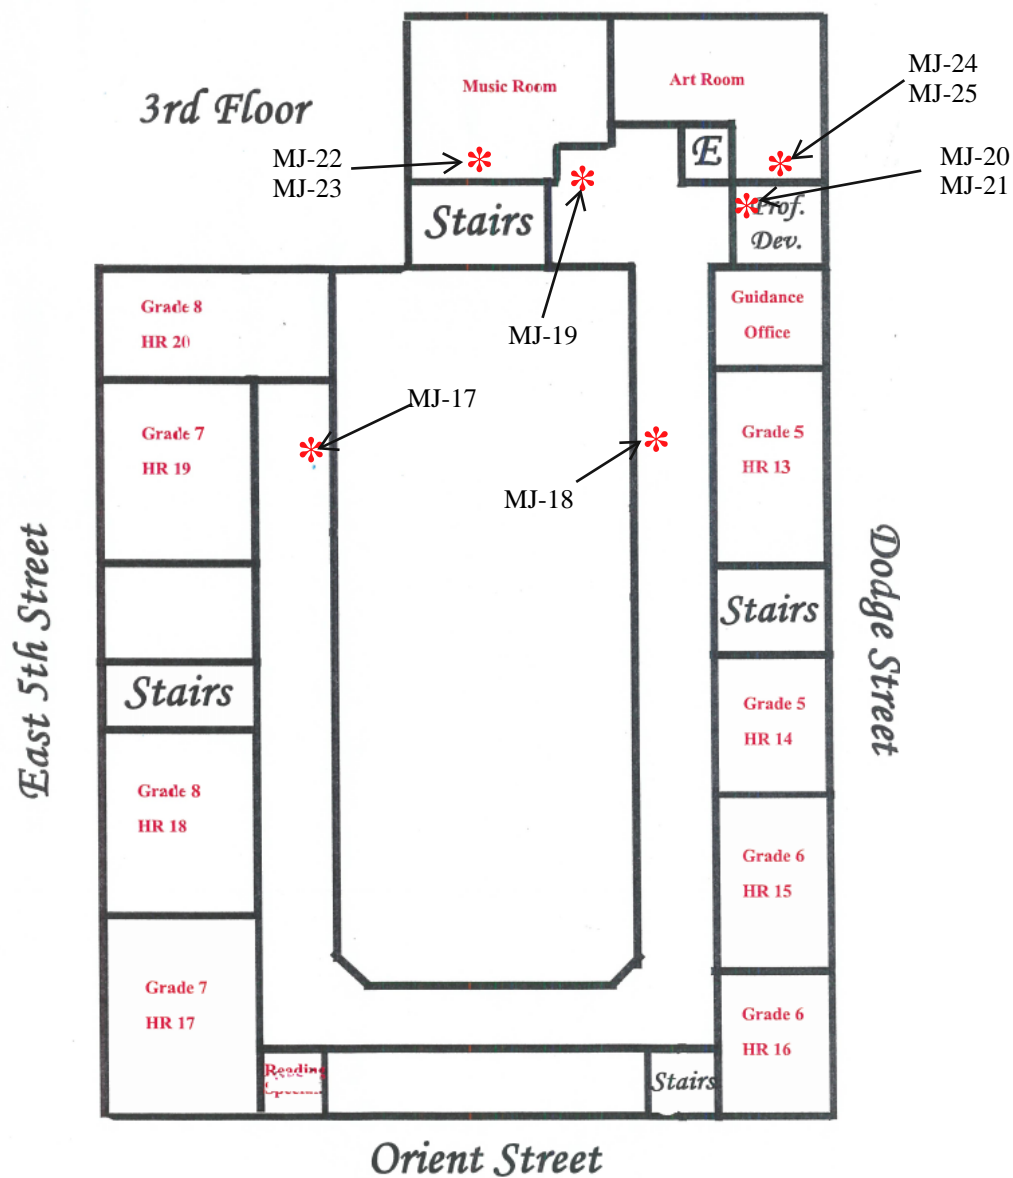

**Key:**

\* = Drinking Water Sampling Location