



464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

LEAD IN DRINKING WATER TESTING REPORT

Conducted for:

Bayonne Board of Education
669 Avenue A
Bayonne, New Jersey 07002

Conducted at:

Nicholas Oresko Community School
33 E 24th Street
Bayonne, New Jersey 07002

Submitted by:

McCabe Environmental Services, L.L.C.
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

REPORT DATE: October 25, 2022

MES PROJECT NO.: 22-04448

Prepared by:

A handwritten signature in blue ink, appearing to read 'Brandon Soto'.

Brandon Soto

Environmental Scientist

Signed for the Company by:

A handwritten signature in blue ink, appearing to read 'John H. Chiaviello'.

John H. Chiaviello
Vice President

TABLE OF CONTENTS

	<u>Page</u>
1.0 INTRODUCTION	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS	2
5.0 DISCUSSION AND CONCLUSION	3

APPENDIX A

Laboratory Certificates of Analysis
&
Sample Chain of Custody Forms

APPENDIX B

School District Sampling Attachments

1.0 INTRODUCTION

McCabe Environmental Services, L.L.C. (McCabe) was retained by Bayonne Board of Education (Client) to conduct lead in drinking water testing at Nicholas Oresko Community School.

The project information is as follows:

Client Name: Bayonne Board of Education

Contact Person: Mr. Daniel Castles

Project Name: Nicholas Oresko Community School – Lead in Drinking Water Testing

Project Location: 33 E 24th Street Bayonne, New Jersey 07002

Date(s) of Service: September 8, 2022

McCabe Personnel: Gerard D'Alessio & Brandon Soto

2.0 SCOPE OF WORK

Drinking water testing was performed at Nicholas Oresko Community School 33 E 24th St, Bayonne, NJ on September 8, 2022. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead concentrations. Samples were collected from various potential drinking water outlets located throughout the building.

3.0 PROCEDURES

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards.

4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
NO-01	First Draw - Food Service Faucet Basement	<0.5	Pass	Pass
NO-02	30 Second Flush - Food Service Faucet Basement	<0.5	Pass	Pass
NO-03	First Draw – Room 101 Faucet	1.1	Pass	Pass
NO-04	First Draw – Room 102 Faucet	1.4	Pass	Pass
NO-05	First Draw – Room 107 Faucet	0.8	Pass	Pass
NO-06	First Draw – Chiller by Girls/Boys Bathroom 1 st Floor	<0.5	Pass	Pass
NO-07	First Draw – Room 103 Pre-K Bathroom Sink	<0.5	Pass	Pass
NO-08	First Draw - Room 104 Child Care Center Bathroom Sink	0.8	Pass	Pass
NO-09	30 Second Flush - Room 104 Child Care Center Bathroom Sink	<0.5	Pass	Pass
NO-10	First Draw – Chiller by Girls/Boys Bathroom 2 nd Floor	1.5	Pass	Pass
NO-11	First Draw – Nurse’s Office Faucet	0.6	Pass	Pass
NO-12	First Draw - Chiller by Girls/Boys Bathroom 3 rd Floor	<0.5	Pass	Pass
NO-13	First Draw - Chiller by Girls/Boys Bathroom 4 th Floor	<0.5	Pass	Pass

5.0 DISCUSSION AND CONCLUSION

A total of 13 were collected from Nicholas Oresko Community School. All samples were found to be less than the EPA Lead in Drinking Water at Schools and Child Care Facilities standard of 20 ppb, as well as the EPA Lead and Copper Rule standard of 15 ppb.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building's plumbing is not having an adverse impact on water quality.

APPENDIX A

**LABORATORY CERTIFICATES OF ANALYSIS
&
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, September 19, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
SDG ID: GCM26975
Sample ID#s: CM26975 - CM26987

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

September 19, 2022

SDG I.D.: GCM26975

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
NO-01	CM26975	DRINKING WATER
NO-02	CM26976	DRINKING WATER
NO-03	CM26977	DRINKING WATER
NO-04	CM26978	DRINKING WATER
NO-05	CM26979	DRINKING WATER
NO-06	CM26980	DRINKING WATER
NO-07	CM26981	DRINKING WATER
NO-08	CM26982	DRINKING WATER
NO-09	CM26983	DRINKING WATER
NO-10	CM26984	DRINKING WATER
NO-11	CM26985	DRINKING WATER
NO-12	CM26986	DRINKING WATER
NO-13	CM26987	DRINKING WATER



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:33
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26975

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/17/22	CPP	E200.8
Total Metal Digestion	Completed							09/12/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:35
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26976

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/17/22	CPP	E200.8
Total Metal Digestion	Completed							09/12/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:42
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26977

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.1	0.5	2	ppb	15			09/17/22	CPP	E200.8
Total Metal Digestion	Completed							09/12/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:43
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26978

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.4	0.5	2	ppb	15			09/17/22	CPP	E200.8
Total Metal Digestion	Completed							09/12/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:45
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26979

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:48
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26980

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:51
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26981

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:52
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26982

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:56
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26983

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

5:58
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26984

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

6:00
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26985

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

6:02
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26986

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 19, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/08/22
09/08/22

Time

6:08
17:33

Laboratory Data

SDG ID: GCM26975
Phoenix ID: CM26987

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: NO-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/15/22	TH	E200.8
Total Metal Digestion	Completed							09/13/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 19, 2022

Reviewed and Released by: Rashmi Makol, Project Manager

Analysis Report - Summary

September 19, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCM26975



Sample	Client Id	Col Date	Parameter	Result	RL	CL	Units	Date Analyzed	Reference
Project: 22-04448 Bayonne Board Of Education									
CM26975	NO-01	09/08/22	Lead	< 0.5	0.5		ppb	09/17/22	E200.8
CM26976	NO-02	09/08/22	Lead	< 0.5	0.5		ppb	09/17/22	E200.8
CM26977	NO-03	09/08/22	Lead	1.1	0.5		ppb	09/17/22	E200.8
CM26978	NO-04	09/08/22	Lead	1.4	0.5		ppb	09/17/22	E200.8
CM26979	NO-05	09/08/22	Lead	0.8	0.5		ppb	09/15/22	E200.8
CM26980	NO-06	09/08/22	Lead	< 0.5	0.5		ppb	09/15/22	E200.8
CM26981	NO-07	09/08/22	Lead	< 0.5	0.5		ppb	09/15/22	E200.8
CM26982	NO-08	09/08/22	Lead	0.8	0.5		ppb	09/15/22	E200.8
CM26983	NO-09	09/08/22	Lead	< 0.5	0.5		ppb	09/15/22	E200.8
CM26984	NO-10	09/08/22	Lead	1.5	0.5		ppb	09/15/22	E200.8
CM26985	NO-11	09/08/22	Lead	0.6	0.5		ppb	09/15/22	E200.8
CM26986	NO-12	09/08/22	Lead	< 0.5	0.5		ppb	09/15/22	E200.8
CM26987	NO-13	09/08/22	Lead	< 0.5	0.5		ppb	09/15/22	E200.8

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit

Phyllis Shiller
Laboratory Director
September 19, 2022



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



QA/QC Report

September 19, 2022

QA/QC Data

SDG I.D.: GCM26975

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 641632A (mg/L), QC Sample No: CM26969 2X (CM26975, CM26976, CM26977, CM26978)

ICP MS Metals - Aqueous

Lead	BRL	0.0005				109			108			85 - 115	20
------	-----	--------	--	--	--	-----	--	--	-----	--	--	----------	----

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 70-130%.

QA/QC Batch 641804 (mg/L), QC Sample No: CM26979 2X (CM26979, CM26980, CM26981, CM26982, CM26983, CM26984, CM26985, CM26986, CM26987)

ICP MS Metals - Aqueous


Lead	BRL	0.0005	0.0008	0.0008	NC	107			102			85 - 115	20
------	-----	--------	--------	--------	----	-----	--	--	-----	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 70-130%.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

RPD - Relative Percent Difference
LCS - Laboratory Control Sample
LCSD - Laboratory Control Sample Duplicate
MS - Matrix Spike
MS Dup - Matrix Spike Duplicate
NC - No Criteria
Intf - Interference


Phyllis Shiller, Laboratory Director
September 19, 2022

Monday, September 19, 2022

Criteria: NJ: DW

State: NJ

Sample Criteria Exceedances Report

GCM26975 - MCCABE

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
--------	-------	-----------------	----------	--------	----	----------	----------------	-------------------

*** No Data to Display ***

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Comments

September 19, 2022

SDG I.D.: GCM26975

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

LEAD in DRINKING WATER CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Nicholas Oresko Community School 33 E 24th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard DAPES		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/08/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	N0-01	Fd - Food service faucet Basement	05:33	LEAD - 200.8
DW	N0-02	30 second Aug. Food service faucet Basement	05:35	LEAD - 200.8
DW	N0-03	Fd - Room 101 faucet	05:42	LEAD - 200.8
DW	N0-04	Fd - Room 102 faucet	05:43	LEAD - 200.8
DW	N0-05	Fd - Room 103 faucet	05:45	LEAD - 200.8
DW	N0-06	Fd - Chiller by Girl's/Boys Bathroom ^{1st floor}	05:48	LEAD - 200.8
DW	N0-07	Fd - Room 104 Prek Bathroom Sink	05:51	LEAD - 200.8
DW	N0-08	Fd - Room 104 childcare center	05:52	LEAD - 200.8
DW	N0-09	30 sec flush - Room 104 childcare center	05:56	LEAD - 200.8
DW	N0-10	Fd - Chiller by Boys Bathroom ^{2nd floor}	05:58	LEAD - 200.8

Relinquished by (Print) Gerard DAPES	Date: 09/08/22	Received by: (Print) PAAD	Date: 9/8/22
Signature: [Signature]		Signature: [Signature]	
Relinquished by (Print) PAAD	Date: 9/8/22	Received by: (Print) [Signature]	Date: 9/8/22
Signature: [Signature]		Signature: [Signature]	

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE

2.2 WCLP

McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lyndhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Nicholas Oresko Community School 33 E 24th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/08/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	NO-11	Fdx - Nurse's Office ^{target} sink	6:00	LEAD - 200.8
DW	NO-12	Fdx - Chiller by girls/Boys Bathroom ^{3rd floor}	6:02	LEAD - 200.8
DW	NO-13	Fdx - Chiller by girls/Boys Bathroom ^{4th floor}	6:08	LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Date: 09/08/22	Received by: (Print) Kato Caffen	Date: 9/8/22
Signature: Leonard	Time:	Signature: Brad Cu	Time: 7:25
Relinquished by (Print) Brad Cu	Date:	Received by: (Print) MZ	Date: 9/8
Signature: Brad Cu	Time:	Signature:	Time: 17:33

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

26985

26986

26987

NJ Certified WBE

APPENDIX B

**SCHOOL DISTRICT SAMPLING
ATTACHMENTS**

Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Nicholas Oresko Community School	09/08/22	Phoenix Environmental Laboratories Inc.	

Attachment B – Plumbing Profile

Note: Complete for each school. For additional information see the USEPA publication, "The 3Ts for Reducing Lead in Drinking Water in Schools"

Name of School: Nicholas Oresko Community School Levels: K-8

Address: 33 East 24th St., Bayonne, NJ 07002

Individual school project officer Signature: *Scott Nolan* Date: August 2002

Questions	Answers
Background Information	
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	K-8 Grade School Built in 2008
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Any repairs made after 2008 were done with lead free solder
3. Where are the most recent plumbing repairs and replacements?	<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;">Location:</div> <div style="width: 45%;">Description:</div> </div>
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;">Material: Duct iron</div> <div style="width: 45%;">Location: The water main (east 24th St) enters the basement rooms flows through the water meter and continues to the remainder of the building</div> </div>
5. Is there point of entry (POE) or point of use (POU) treatment in use?	<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;">Y / N No treatment of water Type: at POE</div> <div style="width: 45%;">Main building 2008 Location:</div> </div> <div style="text-align: center; margin-top: 5px;">City water comes treated</div>

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N Yes Building has a 40 gallon and 100 gallon reserve hot water storage tank located in 3rd floor boiler room
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	Yes, Scott Nolan, Andy McCabe, Vinny Caiola, change filters on an as needed basis assign plumbers
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N Yes The district has set-up a routine maintenance program to clean screens
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N NO Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: <ul style="list-style-type: none"> • Name of contaminant(s) • Concentrations found • pH level Is testing done regularly at the building?	No indoor testing by public water supplier
11. Other plumbing background questions include: <ul style="list-style-type: none"> • Are blueprints of the building available? • Are there known plumbing “dead-ends”, low use areas, existing leaks or other “problem areas”? Are renovations planned for any of the plumbing system?	Not all prints are available No dead-end low use areas All leaks were identified during walk through and ahve been repaired No plumbing system renovations planned

Questions	Answers
Walk-Through	
These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.	
1. Confirm the material of Service Line visually.	Duct iron
2. Confirm the presence of POE or POU treatment.	No POE or POU treatment
3. What are the potable water pipes made of in your facility? <ul style="list-style-type: none">• Lead• Plastic• Galvanized Metal• Cast Iron• Copper• Other Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Copper
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N No No electrical wires grounded to water pipes
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Location: Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes Completed in Attachment C - Water Outlet Inventory
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory.

Questions	Answers
<p>7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit?</p> <p>Recalled Drinking Water Fountains</p> <p>Make and Model</p>	<p>Y / N Yes all water coolers have been checked and compared to the list of recalled water coolers</p>
<p>Note the locations of water outlets.</p>	<p>Type None on the list of recalled water coolers</p>
<p>8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected?</p> <p>Note the locations of water outlets.</p> <p>9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily?</p> <p>Permanently</p> <p>Temporarily</p>	<p>Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory.</p> <p>Y / N</p> <p>Complete "Operational Column" in Attachment C- Drinking Water Outlet Inventory.</p> <p>Type/ Location</p> <p>Description</p>

Attachment C – Drinking Water Outlet Inventory

Name of School: Nicholas Oresko Community School

Address: 33 E 24th Street Bayonne, New Jersey 07002

Grade Levels: Elementary School Year School Constructed: Unknown Renovated/Additions: NA

Individual School Project Officer: Scott Nolan

Date Completed: 09/30/22

# ¹	Type	Location	Code	Operational ² (Y/N)	Signs of Corrosion ³ (Y/N)	Filter ⁴ (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Sink	Food Service Basement	NO-01	Y	N	N	N	Y	N	N	NA	NA	
02	Sink	Food Service Basement	NO-02	Y	N	N	N	Y	N	N	NA	NA	Flush
03	Sink	Room 101	NO-03	Y	N	N	N	N	N	N	NA	NA	
04	Sink	Room 102	NO-04	Y	N	N	N	Y	N	N	NA	NA	
05	Sink	Room 107	NO-05	Y	N	N	N	N	N	N	NA	NA	
06	Chiller	By Girls/Boys Bathroom 1st Floor	NO-06	Y	N	Y	N	N	N	Y	NA	NA	
07	Sink	Room 103 Pre-K Bathroom	NO-07	Y	N	N	N	N	Y	N	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

² Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

³ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

⁴ Document on Attachment D- Filter Inventory.

08	Sink	Room 104 Child Care Center Bathroom	NO-08	Y	N	N	N	N	Y	N	NA	NA	
09	Sink	Room 104 Child Care Center Bathroom	NO-09	Y	N	N	N	N	Y	N	NA	NA	Flush
10	Chiller	By Girls/Boys Bathroom 2nd Floor	NO-10	Y	N	Y	N	N	N	Y	NA	NA	
11	Sink	Nurse's Office	NO-11	Y	N	N	N	N	N	N	NA	NA	
12	Chiller	By Girls/Boys Bathroom 3rd Floor	NO-12	Y	N	Y	N	N	N	Y	NA	NA	
13	Chiller	By Girls/Boys Bathroom 4th Floor	NO-13	Y	N	Y	N	N	N	Y	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

¹ Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

¹ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

¹ Document on Attachment D- Filter Inventory.

Attachment D - Filter Inventory

Name of School: Nicholas Oresko Community School

Grade Levels: Elementary School

Address: 33 E 24th Street Bayonne, New Jersey 07002

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
NO-01	N/A	N/A	N/A	N/A	N/A
NO-02	N/A	N/A	N/A	N/A	N/A
NO-03	N/A	N/A	N/A	N/A	N/A
NO-04	N/A	N/A	N/A	N/A	N/A
NO-05	N/A	N/A	N/A	N/A	N/A
NO-06	Elkay	EZFS8_1B	N/A	N/A	N/A
NO-07	N/A	N/A	N/A	N/A	N/A
NO-08	N/A	N/A	N/A	N/A	N/A
NO-09	N/A	N/A	N/A	N/A	N/A
NO-10	Elkay	EZFS8_1B	N/A	N/A	N/A
NO-11	N/A	N/A	N/A	N/A	N/A
NO-12	Elkay	EZFS8_1B	N/A	N/A	N/A
NO-13	Elkay	EZFS8_1B	N/A	N/A	N/A

Attachment E – Flushing Log

Name of School: Nicholas Oresko Community School

Address: 33 E 24th Street Bayonne, New Jersey 07002

Grade Levels: Elementary School


Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Food Service Faucet Basement	NO-01	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Food Service Faucet Basement	NO-02	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 101 Faucet	NO-03	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 102 Faucet	NO-04	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 107 Faucet	NO-05	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Girls/Boys Bathroom 1st Floor	NO-06	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 103 Pre-K Bathroom Sink	NO-07	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 104 Child Care Center Bathroom Sink	NO-08	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 104 Child Care Center Bathroom Sink	NO-09	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Girls/Boys Bathroom 2nd Floor	NO-10	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Nurse's Office Faucet	NO-11	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Girls/Boys Bathroom 3rd Floor	NO-12	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Girls/Boys Bathroom 4th Floor	NO-13	September 7, 2022	5:30 pm	2-3 Minutes	Water Sampling


Attachment F - Pre - Sampling Water Use Certification

TO BE COMPLETED BY THE BAYONNE BOE DISTRICT REPRESENTATIVE:		
School Name: <u>Nicholas Oresko Community School</u>		
Sample collection address:	<u>33 E 24th Street, Bayonne, New Jersey 07002</u>	
Water was last used:	<u>Time: 5:30 pm</u>	<u>Date: January 10, 2022</u>
Sample commencement:	<u>Time: 5:33 am</u>	<u>Date: January 11, 2022</u>
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Scott Nolan	09/30/22	
Signature	Date	

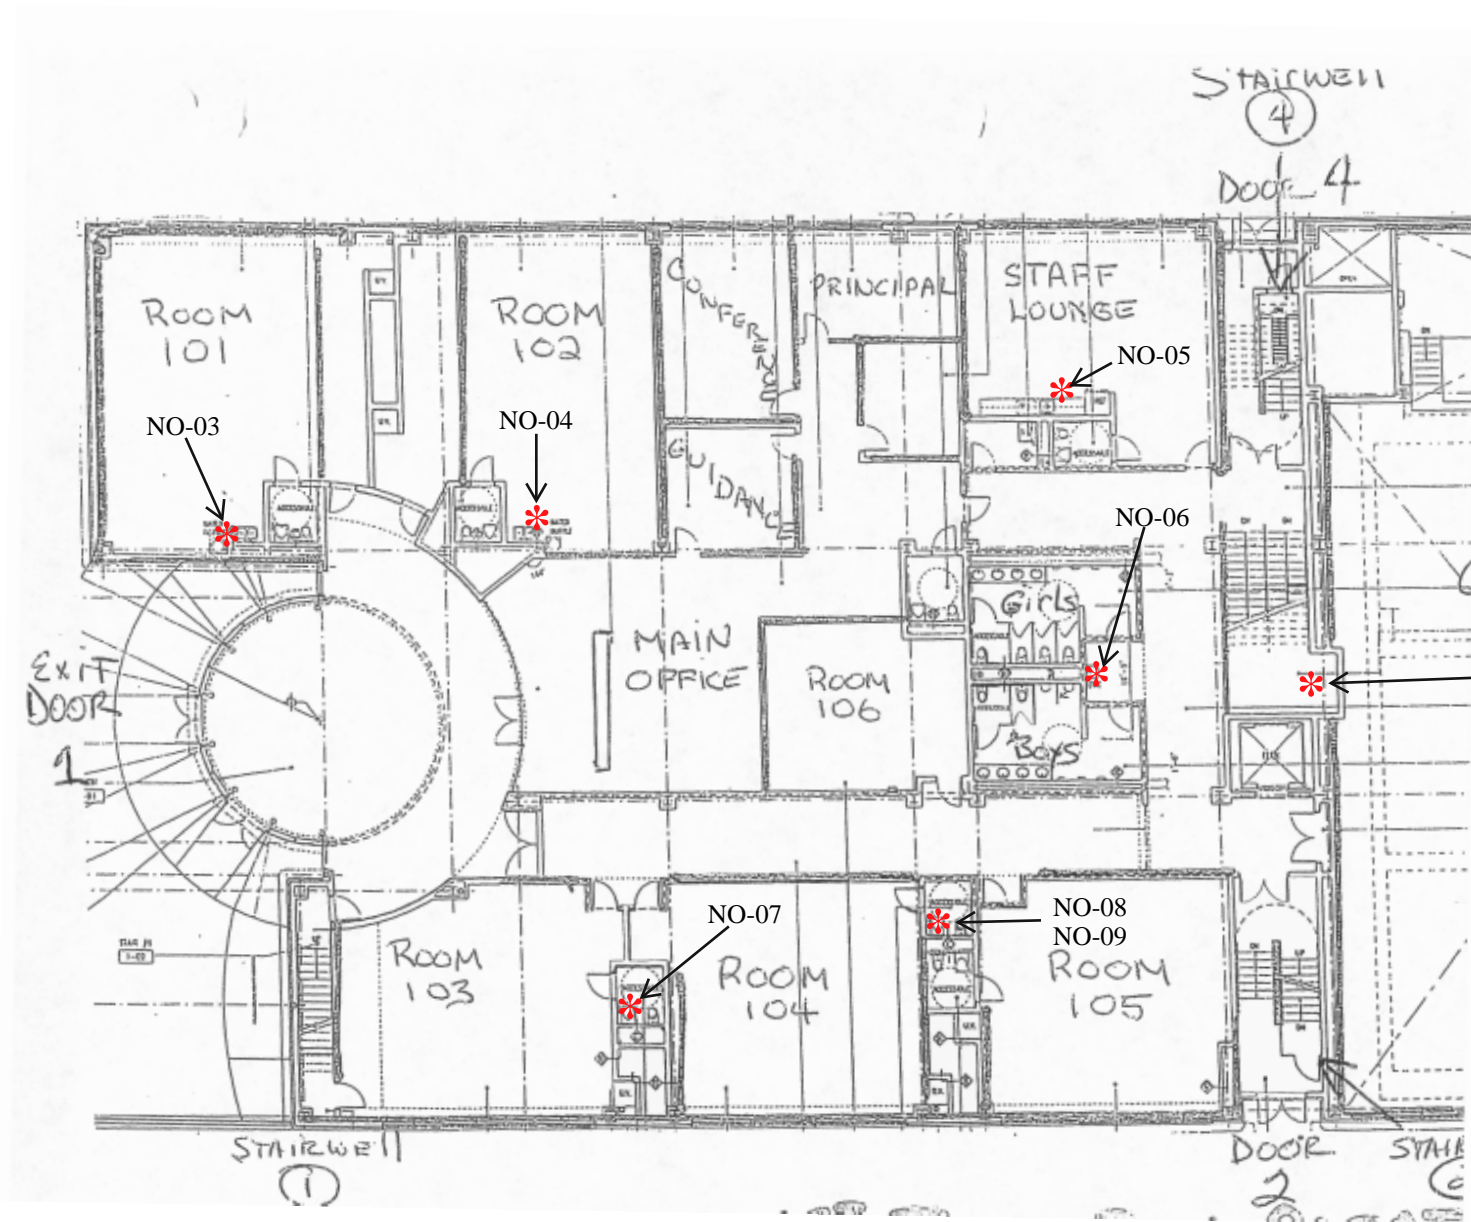


Key:

* = Drinking Water Sampling Location

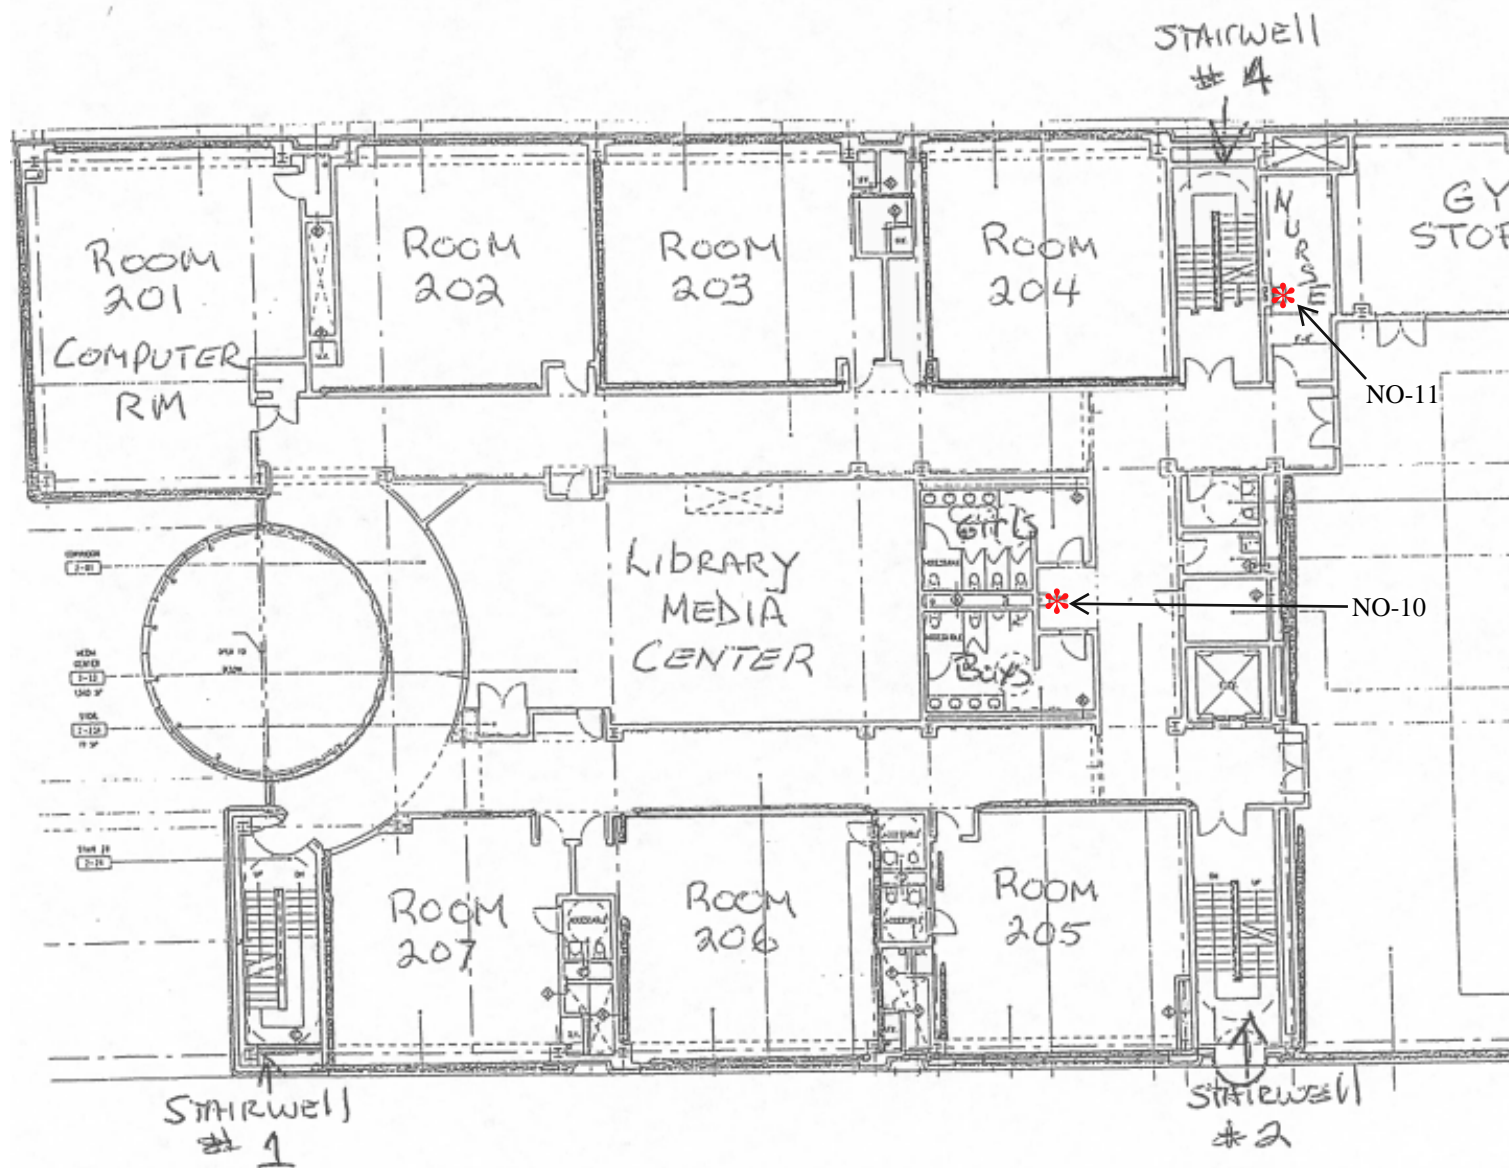

Key:


* = Drinking Water Sampling Location

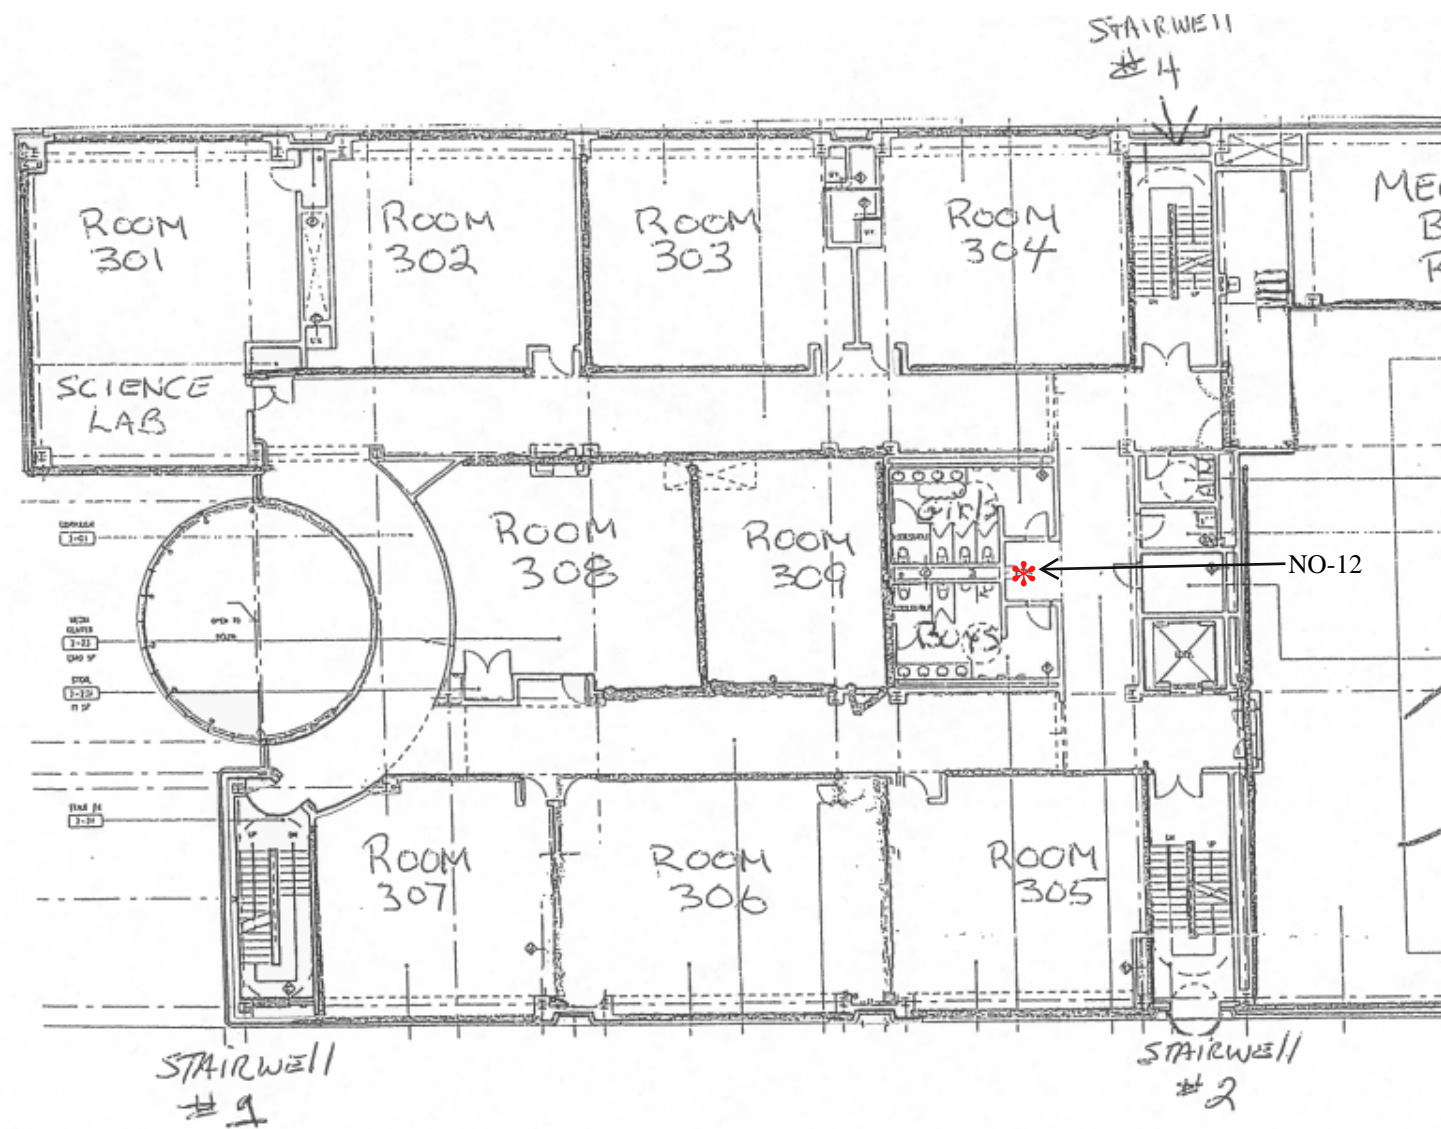

Key:

* = Drinking Water Sampling Location

NO-13

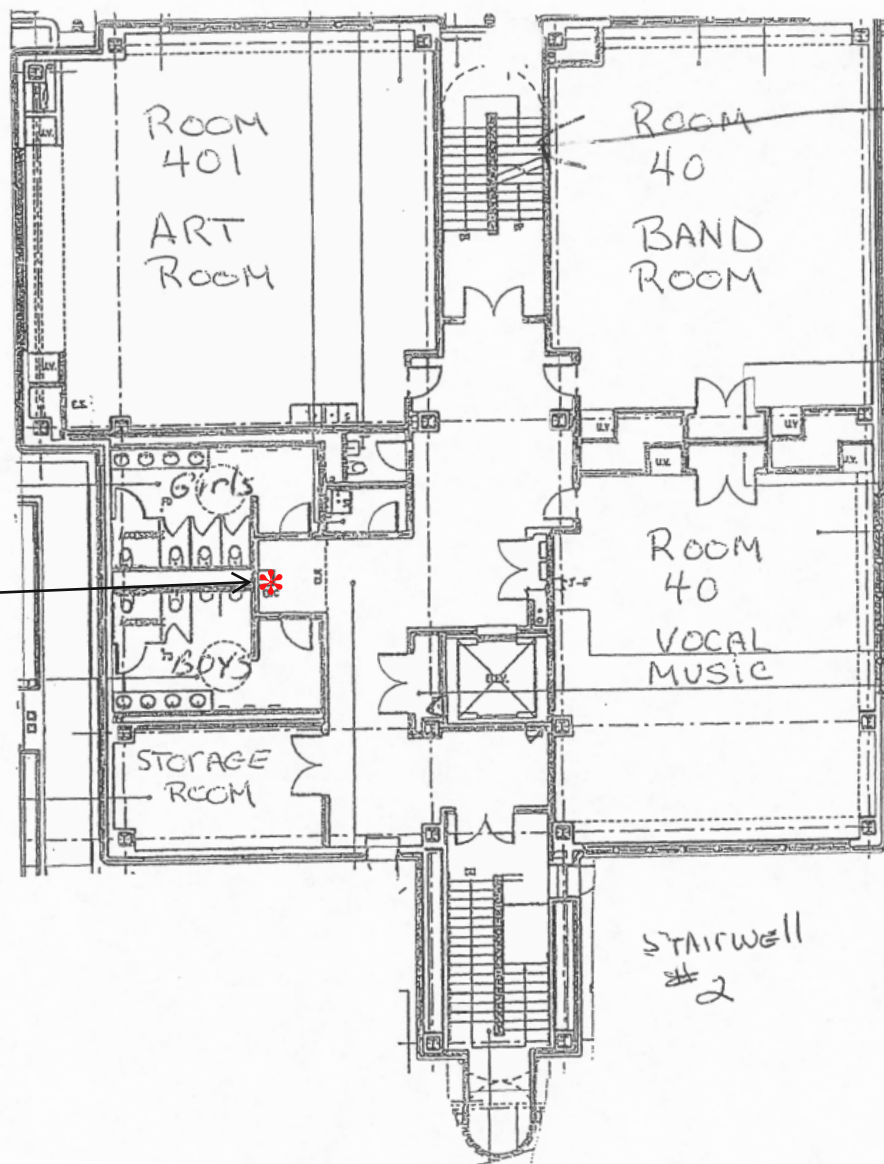

Key:

* = Drinking Water Sampling Location