



464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

LEAD IN DRINKING WATER TESTING REPORT

Conducted for:

Bayonne Board of Education
669 Avenue A
Bayonne, New Jersey 07002

Conducted at:

Woodrow Wilson Community School
101 West 56th Street
Bayonne, New Jersey 07002

Submitted by:

McCabe Environmental Services, L.L.C.
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

REPORT DATE: October 25, 2022

MES PROJECT NO.: 22-04448

Prepared by:

A handwritten signature in blue ink, appearing to read 'A. Capalbo'.

Angela Capalbo
Environmental Scientist

Signed for the Company by:

A handwritten signature in blue ink, appearing to read 'John H. Chiaviello'.

John H. Chiaviello
Vice President

TABLE OF CONTENTS

	<u>Page</u>
1.0 INTRODUCTION	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS	2
5.0 DISCUSSION AND CONCLUSION	4

APPENDIX A

Laboratory Certificates of Analysis
&
Sample Chain of Custody Forms

APPENDIX B

School District Sampling Attachments

1.0 INTRODUCTION

McCabe Environmental Services, L.L.C. (McCabe) was retained by Bayonne Board of Education (Client) to conduct lead in drinking water testing at the Woodrow Wilson Community School located at 101 West 56th Street, Bayonne, New Jersey.

The project information is as follows:

<u>Client Name:</u>	Bayonne Board of Education
<u>Contact Person:</u>	Mr. Daniel Castles
<u>Project Name:</u>	Woodrow Wilson Community School Lead in Drinking Water
<u>Project Location:</u>	101 West 56th Street Bayonne, New Jersey
<u>Date(s) of Service:</u>	August 31, 2022
<u>McCabe Personnel:</u>	Gerard D'Alessio

2.0 SCOPE OF WORK

Drinking water testing was performed at the Woodrow Wilson Community School located at 101 West 56th Street, Bayonne, New Jersey on August 31, 2022. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead concentrations. Samples were collected from various potential drinking water outlets located throughout the building.

3.0 PROCEDURES

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards.

4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
WW-01	First Draw – Chiller Outside Mezzanine Boy's Bathroom	< 0.5	Pass	Pass
WW-02	30 Second Draw – Chiller Outside Mezzanine Boy's Bathroom	< 0.5	Pass	Pass
WW-03	First Draw – Chiller Next to Elevator Subbasement	< 0.5	Pass	Pass
WW-04	First Draw – Lunchroom Kitchen Subbasement	0.6	Pass	Pass
WW-05	First Draw – Bubbler Outside Girl's Bathroom	< 0.5	Pass	Pass
WW-06	First Draw – Room 100 Bathroom Sink	1.5	Pass	Pass
WW-07	First Draw – Room 101 Bathroom Sink	1.2	Pass	Pass
WW-08	First Draw – Room 102 Faucet	0.6	Pass	Pass
WW-09	30 Second Flush – Room 102 Faucet	< 0.5	Pass	Pass
WW-10	First Draw – Room 103 Faucet	< 0.5	Pass	Pass
WW-11	First Draw – Bubbler Across from Room 103	10.7	Pass	Pass
WW-12	First Draw – Bubbler Across from Main Office	1.7	Pass	Pass
WW-13	First Draw – Room 105 Faucet	0.6	Pass	Pass
WW-14	First Draw – Room 106 Faucet	4.2	Pass	Pass
WW-15	First Draw – 107 Bathroom Sink	0.6	Pass	Pass
WW-16	First Draw – Engineer Breakroom Sink	8.5	Pass	Pass
WW-17	30 Second Flush – Engineer Breakroom Sink	0.9	Pass	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
WW-18	First Draw – Bubbler Across Boy's Bathroom	0.8	Pass	Pass
WW-19	First Draw – Chiller by Elevator, First Floor	< 0.5	Pass	Pass
WW-20	First Draw – Bubbler Across from Girl's Room, Second Floor	1.3	Pass	Pass
WW-21	First Draw – Bubbler Across from Room 205	6.3	Pass	Pass
WW-22	First Draw – Bubbler Across from Room 208	1.3	Pass	Pass
WW-23	First Draw – Room 209 Faucet	0.7	Pass	Pass
WW-24	First Draw – Room 211 Faucet	0.9	Pass	Pass
WW-25	First Draw – Nurse's Office Faucet	0.8	Pass	Pass
WW-26	First Draw – Bubbler Across Boy's Bathroom	0.9	Pass	Pass
WW-27	First Draw – Chiller by Elevator, Second Floor	< 0.5	Pass	Pass
WW-28	First Draw – Art Room, Right Faucet	2	Pass	Pass
WW-29	First Draw – Bubbler Across from Art Room	1.1	Pass	Pass
WW-30	First Draw – Bubbler Across from Room 306	11	Pass	Pass
WW-31	First Draw – Bubbler Across from Room 311	10.2	Pass	Pass
WW-32	First Draw – Bubbler Across from Room 315	0.6	Pass	Pass
WW-33	First Draw – Chiller by Elevator, Third Floor	< 0.5	Pass	Pass

5.0 DISCUSSION AND CONCLUSION

A total of thirty-three (33) samples were collected from the Woodrow Wilson Community School. All samples were found to be less than the EPA Lead in Drinking Water at Schools and Child Care Facilities standard of 20 ppb, as well as the EPA Lead and Copper Rule standard of 15 ppb.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building's plumbing is not having an adverse impact on water quality.

APPENDIX A

**LABORATORY CERTIFICATES OF ANALYSIS
&
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, September 12, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
SDG ID: GCM21507
Sample ID#s: CM21507 - CM21539

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21507

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
WW-01	CM21507	DRINKING WATER
WW-02	CM21508	DRINKING WATER
WW-03	CM21509	DRINKING WATER
WW-04	CM21510	DRINKING WATER
WW-05	CM21511	DRINKING WATER
WW-06	CM21512	DRINKING WATER
WW-07	CM21513	DRINKING WATER
WW-08	CM21514	DRINKING WATER
WW-09	CM21515	DRINKING WATER
WW-10	CM21516	DRINKING WATER
WW-11	CM21517	DRINKING WATER
WW-12	CM21518	DRINKING WATER
WW-13	CM21519	DRINKING WATER
WW-14	CM21520	DRINKING WATER
WW-15	CM21521	DRINKING WATER
WW-16	CM21522	DRINKING WATER
WW-17	CM21523	DRINKING WATER
WW-18	CM21524	DRINKING WATER
WW-19	CM21525	DRINKING WATER
WW-20	CM21526	DRINKING WATER
WW-21	CM21527	DRINKING WATER
WW-22	CM21528	DRINKING WATER
WW-23	CM21529	DRINKING WATER
WW-24	CM21530	DRINKING WATER
WW-25	CM21531	DRINKING WATER
WW-26	CM21532	DRINKING WATER
WW-27	CM21533	DRINKING WATER
WW-28	CM21534	DRINKING WATER
WW-29	CM21535	DRINKING WATER
WW-30	CM21536	DRINKING WATER



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21507

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
WW-31	CM21537	DRINKING WATER
WW-32	CM21538	DRINKING WATER
WW-33	CM21539	DRINKING WATER



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

5:45
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21507

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

5:48
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21508

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

5:52
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21509

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

5:55
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21510

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:00
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21511

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:04
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21512

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:08
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21513

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.2	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:10
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21514

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:12
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21515

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:15
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21516

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:18
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21517

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	10.7	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:19
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21518

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.7	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:20
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21519

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:22
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21520

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-14

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	4.2	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:24
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21521

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-15

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:25
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21522

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-16

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	8.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:27
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21523

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-17

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:29
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21524

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-18

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:32
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21525

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-19

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:35
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21526

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-20

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.3	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:40
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21527

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-21

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	6.3	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:42
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21528

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-22

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.3	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:46
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21529

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-23

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.7	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:49
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21530

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-24

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:51
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21531

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-25

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:53
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21532

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-26

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

6:55
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21533

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-27

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:02
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21534

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-28

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:05
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21535

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-29

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.1	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:08
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21536

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-30

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	11	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:10
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21537

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-31

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	10.2	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:12
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21538

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-32

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.6	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

7:14
18:30

Laboratory Data

SDG ID: GCM21507
Phoenix ID: CM21539

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: WW-33

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.5	0.5	2	ppb	15			09/10/22	CPP	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager

Analysis Report - Summary

September 12, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCM21507




Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
Project: 22-04448 Bayonne Board Of Education								
CM21507	WW-01	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21508	WW-02	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21509	WW-03	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21510	WW-04	09/01/22	Lead	0.6	0.5	ppb	09/10/22	E200.8
CM21511	WW-05	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21512	WW-06	09/01/22	Lead	1.5	0.5	ppb	09/10/22	E200.8
CM21513	WW-07	09/01/22	Lead	1.2	0.5	ppb	09/10/22	E200.8
CM21514	WW-08	09/01/22	Lead	0.6	0.5	ppb	09/10/22	E200.8
CM21515	WW-09	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21516	WW-10	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21517	WW-11	09/01/22	Lead	10.7	0.5	ppb	09/10/22	E200.8
CM21518	WW-12	09/01/22	Lead	1.7	0.5	ppb	09/10/22	E200.8
CM21519	WW-13	09/01/22	Lead	0.6	0.5	ppb	09/10/22	E200.8
CM21520	WW-14	09/01/22	Lead	4.2	0.5	ppb	09/10/22	E200.8
CM21521	WW-15	09/01/22	Lead	0.6	0.5	ppb	09/10/22	E200.8
CM21522	WW-16	09/01/22	Lead	8.5	0.5	ppb	09/10/22	E200.8
CM21523	WW-17	09/01/22	Lead	0.9	0.5	ppb	09/10/22	E200.8
CM21524	WW-18	09/01/22	Lead	0.8	0.5	ppb	09/10/22	E200.8
CM21525	WW-19	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21526	WW-20	09/01/22	Lead	1.3	0.5	ppb	09/10/22	E200.8
CM21527	WW-21	09/01/22	Lead	6.3	0.5	ppb	09/10/22	E200.8
CM21528	WW-22	09/01/22	Lead	1.3	0.5	ppb	09/10/22	E200.8
CM21529	WW-23	09/01/22	Lead	0.7	0.5	ppb	09/10/22	E200.8
CM21530	WW-24	09/01/22	Lead	0.9	0.5	ppb	09/10/22	E200.8
CM21531	WW-25	09/01/22	Lead	0.8	0.5	ppb	09/10/22	E200.8

Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
CM21532	WW-26	09/01/22	Lead	0.9	0.5	ppb	09/10/22	E200.8
CM21533	WW-27	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8
CM21534	WW-28	09/01/22	Lead	2	0.5	ppb	09/10/22	E200.8
CM21535	WW-29	09/01/22	Lead	1.1	0.5	ppb	09/10/22	E200.8
CM21536	WW-30	09/01/22	Lead	11	0.5	ppb	09/10/22	E200.8
CM21537	WW-31	09/01/22	Lead	10.2	0.5	ppb	09/10/22	E200.8
CM21538	WW-32	09/01/22	Lead	0.6	0.5	ppb	09/10/22	E200.8
CM21539	WW-33	09/01/22	Lead	< 0.5	0.5	ppb	09/10/22	E200.8

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit


 Phyllis Shiller
 Laboratory Director
 September 12, 2022



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



QA/QC Report

September 12, 2022


QA/QC Data

SDG I.D.: GCM21507

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
QA/QC Batch 640736A (mg/L), QC Sample No: CM21505 2X (CM21507, CM21508, CM21509, CM21510, CM21511, CM21512, CM21513, CM21514)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001				103			100				
Comment:													
This batch does not include a duplicate.													
QA/QC Batch 640737 (mg/L), QC Sample No: CM21515 2X (CM21515, CM21516, CM21517, CM21518, CM21519, CM21520, CM21521, CM21522, CM21523, CM21524)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001	<0.0005	0.0001	NC	101			98.2				
QA/QC Batch 640737A (mg/L), QC Sample No: CM21525 2X (CM21525, CM21526, CM21527, CM21528, CM21529, CM21530, CM21531, CM21532, CM21533, CM21534)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001				101			97.6				
Comment:													
This batch does not include a duplicate.													
QA/QC Batch 640738 (mg/L), QC Sample No: CM21535 2X (CM21535, CM21536, CM21537, CM21538, CM21539)													
<u>ICP MS Metals - Aqueous</u>													
Lead	BRL	0.0001	0.0011	0.0011	NC	101			99.0				

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

RPD - Relative Percent Difference
LCS - Laboratory Control Sample
LCSD - Laboratory Control Sample Duplicate
MS - Matrix Spike
MS Dup - Matrix Spike Duplicate
NC - No Criteria
Intf - Interference


Phyllis Shiller, Laboratory Director
September 12, 2022

Monday, September 12, 2022

Criteria: NJ: DW
State: NJ

Sample Criteria Exceedances Report
GCM21507 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
--------	-------	-----------------	----------	--------	----	----------	----------------	-------------------

*** No Data to Display ***

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Comments

September 12, 2022

SDG I.D.: GCM21507

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lyndhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Woodrow Wilson Community School 101 W 56th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	WW-01	first draw - chiller outside mezzanine in boys bathroom	05:45	LEAD - 200.8
DW	WW-02	30 second flush - chiller outside mezzanine in boys bathroom	05:48	LEAD - 200.8
DW	WW-03	chiller first draw - chiller outside mezzanine in boys bathroom	05:52	LEAD - 200.8
DW	WW-04	first draw - kitchen sink in boys bathroom	05:55	LEAD - 200.8
DW	WW-05	first draw - bubble up outside girls bathroom	06:00	LEAD - 200.8
DW	WW-06	first draw - room 100 Bathroom sink	06:04	LEAD - 200.8
DW	WW-07	first draw - Room 101 Bathroom sink	06:08	LEAD - 200.8
DW	WW-08	first draw - Room 102 Faucet	06:10	LEAD - 200.8
DW	WW-09	30 second flush - Room 102 Faucet	06:12	LEAD - 200.8
DW	WW-10	first draw - Room 103 Faucet	06:15	LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Date:	Received by: (Print) Brad Dy	Date:
Signature: Brad D'Alessio		Signature: Brad Dy	
Relinquished by (Print) Brad Dy	Date:	Received by: (Print) Gaudy At	Date:
Signature: Brad Dy		Signature: Gaudy At	

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

2.56 wip

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Woodrow Wilson Community School 101 W 56th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerald DAlessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 04/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	NW-11	first draw - bubbler across Room 103	06:18	LEAD - 200.8
DW	WW-12	first draw - bubbler across from main entrance	06:19	LEAD - 200.8
DW	WW-13	first draw - Room 105 Faucet	06:20	LEAD - 200.8
DW	WW-14	first draw - Room 106 Faucet	06:22	LEAD - 200.8
DW	WW-15	first draw - Room 107 Bathroom sink	06:24	LEAD - 200.8
DW	WW-16	first draw - Engineer Breakroom sink	06:25	21522 LEAD - 200.8
DW	WW-17	30 second flush - Engineer Breakroom sink	06:27	21523 LEAD - 200.8
DW	WW-18	first draw - bubbler across boys Bathroom	06:24	21524 LEAD - 200.8
DW	WW-19	first draw - Chiller by elevator - first floor	06:32	LEAD - 200.8
DW	WW-20	first draw - bubbler across from girls Room 2nd floor	06:35	LEAD - 200.8

Relinquished by (Print)	Date:	Received by: (Print)	Date:
Signature:		Signature:	
Relinquished by (Print)	Date:	Received by: (Print)	Date:
Signature:		Signature:	

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lyndhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

2.50L WIP

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Woodrow Wilson Community School 101 W 56th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard DA1351.0		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 07/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	WW-21	first draw - ^{from} bubbler across room 205	0640	LEAD - 200.8
DW	WW-22	first draw - ^{from} bubbler across room 208	0642	LEAD - 200.8
DW	WW-23	first draw - room 209 Faucet - Life skills	0646	LEAD - 200.8
DW	WW-24	first draw - Room 211 Faucet	0649	LEAD - 200.8
DW	WW-25	first draw - Nurse's office Faucet	0651	LEAD - 200.8
DW	WW-26	first draw - Bubbler across Boys Bathroom	0653	LEAD - 200.8
DW	WW-27	first draw - Chiller by elevator - 2nd floor	0655	LEAD - 200.8
DW	WW-28	first draw - Room Art Room - Right faucet	0702	LEAD - 200.8
DW	WW-29	first draw - Bubbler across from art room	0705	LEAD - 200.8
DW	WW-30	first draw - Bubbler across from Room 306	0708	LEAD - 200.8

Relinquished by (Print) Gerard DA1351.0	Date:	Received by: (Print) <i>[Signature]</i>	Date:
Signature: <i>[Signature]</i>	Time:	Signature: <i>[Signature]</i>	Time:
Relinquished by (Print) <i>[Signature]</i>	Date:	Received by: (Print) <i>[Signature]</i>	Date:
Signature: <i>[Signature]</i>	Time:	Signature: <i>[Signature]</i>	Time:

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lyndhurst, NJ 07071 • Phone: (201) 438-4839 • Fax: (201) 438-1798

2.5% WUP

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Woodrow Wilson Community School 101 W 56th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	WW-31	First draw - Bubler across from Room 311	0710	LEAD - 200.8
DW	WW-32	First draw - Bubler across from Room 315	0712	LEAD - 200.8
DW	WW-33	First draw - cylinder by elevator - 3rd floor	0714	LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Date:	Received by: (Print) Brad Dy	Date:
Signature: Gerard D'Alessio		Signature: Brad Dy	Time: 9/1/22 206
Relinquished by (Print) Brad Caffrey	Date:	Received by: (Print) Audrey	Date:
Signature: Brad Caffrey		Signature: Audrey	Time: 9/1/22 1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

NJ Certified WBE

APPENDIX B

**SCHOOL DISTRICT SAMPLING
ATTACHMENTS**

Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Woodrow Wilson Community School	August 31, 2022	Phoenix Environmental Laboratories Inc.	

Attachment B – Plumbing Profile

Note: Complete for each school. For additional information see the USEPA publication, "The 3Ts for Reducing Lead in Drinking Water in Schools"

Name of School: Woodrow Wilson Community School Levels: K-8

Address: 101 West 56th St., Bayonne, NJ 07002

Individual school project officer Signature: *Scott Wilson* Date: August 2002

Questions	Answers
Background Information	
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	K-8 Grade School Built in 1930 K-8 Grade School Addition in 2006
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Any repairs made after 1986 were done using lead free solder
3. Where are the most recent plumbing repairs and replacements?	<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> Location: 3rd floor hallway 2nd floor life skills 1st floor Pre-K room </div> <div style="width: 45%;"> Description: Replace water fountain Replace faucet Install new bathroom </div> </div>
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	Material: Main Building - Duct Iron Location: The water main (57th st) enters the basement boiler room where the water meter is located and continues to the remainder of the building
5. Is there point of entry (POE) or point of use (POU) treatment in use?	<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> Y / N No treatment of water Type: at POE City water comes treated </div> <div style="width: 45%;"> Location: Main Building 1930 </div> </div>

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N Yes Building has two 75 gallon hot water storage tanks located in the boiler room and new wing slop sink
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	Yes, Scott Nolan, Andy McCabe, Vinny Caiola, change filters on an as needed basis assign plumbers
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N Yes The district has set-up a routine maintenance program to clean screens
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N NO Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: <ul style="list-style-type: none"> • Name of contaminant(s) • Concentrations found • pH level Is testing done regularly at the building?	No indoor testing by public water supplier
11. Other plumbing background questions include: <ul style="list-style-type: none"> • Are blueprints of the building available? • Are there known plumbing "dead-ends", low use areas, existing leaks or other "problem areas"? Are renovations planned for any of the plumbing system?	Not all prints are available No dead-end low use areas All leaks were identified during walk through and have been repaired No plumbing system renovations planned

Questions	Answers
Walk-Through	<i>These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.</i>
1. Confirm the material of Service Line visually.	Duct iron
2. Confirm the presence of POE or POU treatment.	No POE or POU treatment
3. What are the potable water pipes made of in your facility? <ul style="list-style-type: none"> • Lead • Plastic • Galvanized Metal • Cast Iron • Copper • Other Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Cooper Galvanized Metal Brass Water flow through the building shown on the prints
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N Location: No No electrical wires grounded to water pipes
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes Completed in Attachment C - Water Outlet Inventory
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory.

Questions	Answers
<p>7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit?</p> <p>Recalled Drinking Water Fountains</p> <p>Make and Model</p>	<p>Y / N Yes all water coolers have been checked and compared to the list of recalled water coolers</p>
<p>8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected?</p> <p>Note the locations of water outlets.</p>	<p>Type None on the list of recalled water coolers</p> <p>Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory.</p>
<p>9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily?</p> <p>Permanently</p> <p>Temporarily</p>	<p>Y / N</p> <p>Complete "Operational Column" in Attachment C- Drinking Water Outlet Inventory.</p> <p>Type/ Location</p> <p>Description</p>

Attachment C – Drinking Water Outlet Inventory

Name of School: Woodrow Wilson Community School

Address: 101 West 56th Street, Bayonne, New Jersey 07002

Grade Levels: Elementary School Year School Constructed: Unknown Renovated/Additions: NA

Individual School Project Officer: Scott Nolan

Date Completed: 09/30/22

# ¹	Type	Location	Code	Operational ² (Y/N)	Signs of Corrosion ³ (Y/N)	Filter ⁴ (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Chiller	Outside Mezzanine Boy's Bathroom	WW-01	Y	N	Y	N	N	N	Y	NA	NA	
02	Chiller	Outside Mezzanine Boy's Bathroom	WW-02	Y	N	Y	N	N	N	Y	NA	NA	Flush
03	Chiller	Next to Elevator Subbasement	WW-03	Y	N	N	N	N	N	Y	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

² Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

³ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

⁴ Document on Attachment D- Filter Inventory.

04	Sink	Lunchroom Kitchen Subbasement	WW-04	Y	N	N	N	N	N	N	NA	NA	
05	Water Fountain	Outside Girl's Bathroom	WW-05	Y	N	N	N	N	N	N	NA	NA	
06	Sink	Room 100 Bathroom	WW-06	Y	N	N	N	Y	N	N	NA	NA	
07	Sink	Room 101 Bathroom	WW-07	Y	N	N	N	Y	N	N	NA	NA	
08	Sink	Room 102	WW-08	Y	N	N	N	Y	N	N	NA	NA	
09	Sink	Room 102	WW-09	Y	N	N	N	Y	N	N	NA	NA	Flush
10	Sink	Room 103	WW-10	Y	N	N	N	Y	N	N	NA	NA	
11	Water Fountain	Across from Room 103	WW-11	Y	N	Y	N	N	N	N	NA	NA	
12	Water Fountain	Across from Main Office	WW-12	Y	N	Y	N	N	N	N	NA	NA	
13	Sink	Room 105	WW-13	Y	N	N	N	Y	N	N	NA	NA	
14	Sink	Room 106	WW-14	Y	N	N	N	Y	N	N	NA	NA	
15	Sink	107 Bathroom	WW-15	Y	N	N	N	Y	N	N	NA	NA	
16	Sink	Engineer Breakroom	WW-16	Y	N	N	N	N	N	N	NA	NA	
17	Sink	Engineer Breakroom	WW-17	Y	N	N	N	N	N	N	NA	NA	Flush
18	Water Fountain	Across Boy's Bathroom	WW-18	Y	N	Y	N	N	N	N	NA	NA	
19	Chiller	By Elevator, First Floor	WW-19	Y	N	Y	N	N	N	Y	NA	NA	
20	Water Fountain	Across from Girl's Room, Second Floor	WW-20	Y	N	Y	N	N	N	N	NA	NA	
21	Water Fountain	Across from Room 205	WW-21	Y	N	Y	N	N	N	N	NA	NA	
22	Water Fountain	Across from Room 208	WW-22	Y	Y	Y	N	N	N	N	NA	NA	
23	Sink	Room 209	WW-23	Y	N	N	N	N	N	N	NA	NA	
24	Sink	Room 211	WW-24	Y	N	N	N	Y	N	N	NA	NA	

25	Sink	Nurse's Office	WW-25	Y	N	N	N	Y	N	N	NA	NA	
26	Water Fountain	Across Boy's Bathroom	WW-26	Y	N	Y	N	N	N	N	NA	NA	
27	Chiller	By Elevator, Second Floor	WW-27	Y	N	Y	N	N	N	Y	NA	NA	
28	Sink	Art Room, Right Faucet	WW-28	Y	N	N	N	Y	N	N	NA	NA	
29	Water Fountain	Across from Art Room	WW-29	Y	N	Y	N	N	N	N	NA	NA	
30	Water Fountain	Across from Room 306	WW-30	Y	N	Y	N	N	N	N	NA	NA	
31	Water Fountain	Across from Room 311	WW-31	Y	N	Y	N	N	N	N	NA	NA	
32	Water Fountain	Across from Room 315	WW-32	Y	N	Y	N	N	N	N	NA	NA	
33	Chiller	By Elevator, Third Floor	WW-33	Y	N	Y	N	N	N	Y	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

¹ Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

¹ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

¹ Document on Attachment D- Filter Inventory.

Attachment D - Filter Inventory

Name of School: Woodrow Wilson Community School

Grade Levels: Elementary School

Address: 101 West 56th Street, Bayonne, New Jersey 07002

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
WW-01	Elkay	EZFS8_1B	N/A	N/A	N/A
WW-02	Elkay	EZFS8_1B	N/A	N/A	N/A
WW-03	Elkay	EZFS8_1B	N/A	N/A	N/A
WW-04	N/A	N/A	N/A	N/A	N/A
WW-05	Halsey Taylor	N/A	N/A	N/A	N/A
WW-06	Franke USA	N/A	N/A	N/A	N/A
WW-07	N/A	N/A	N/A	N/A	N/A
WW-08	N/A	N/A	N/A	N/A	N/A
WW-09	N/A	N/A	N/A	N/A	N/A
WW-10	N/A	N/A	N/A	N/A	N/A
WW-11	Halsey Taylor	N/A	N/A	N/A	N/A
WW-12	Halsey Taylor	N/A	N/A	N/A	N/A
WW-13	N/A	N/A	N/A	N/A	N/A
WW-14	N/A	N/A	N/A	N/A	N/A
WW-15	N/A	N/A	N/A	N/A	N/A
WW-16	N/A	N/A	N/A	N/A	N/A
WW-17	N/A	N/A	N/A	N/A	N/A
WW-18	Halsey Taylor	N/A	N/A	N/A	N/A
WW-19	Elkay	EZFS8_1B	N/A	N/A	N/A
WW-20	Elkay	N/A	N/A	N/A	N/A
WW-21	Elkay	N/A	N/A	N/A	N/A

WW-22	Elkay	N/A	N/A	N/A	N/A
WW-23	N/A	N/A	N/A	N/A	N/A
WW-24	N/A	N/A	N/A	N/A	N/A
WW-25	N/A	N/A	N/A	N/A	N/A
WW-26	Halsey Taylor	N/A	N/A	N/A	N/A
WW-27	Elkay	EZFS8_1B	N/A	N/A	N/A
WW-28	N/A	N/A	N/A	N/A	N/A
WW-29	Halsey Taylor	N/A	N/A	N/A	N/A
WW-30	Halsey Taylor	N/A	N/A	N/A	N/A
WW-31	Halsey Taylor	N/A	N/A	N/A	N/A
WW-32	Halsey Taylor	N/A	N/A	N/A	N/A
WW-33	Elkay	EZFS8_1B	N/A	N/A	N/A

Attachment E – Flushing Log

Name of School: Woodrow Wilson Community School

Address: 101 West 56th Street, Bayonne, New Jersey 07002

Grade Levels: Elementary School

Individual School Project Officer: Scott Nolan

Date: 09/30/22

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Chiller Outside Mezzanine Boy's Bathroom	WW-01	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller Outside Mezzanine Boy's Bathroom	WW-02	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
First Draw – Chiller Next to Elevator Subbasement	WW-03	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Lunchroom Kitchen Subbasement	WW-04	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Outside Girl's Bathroom	WW-05	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 100 Bathroom Sink	WW-06	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 101 Bathroom Sink	WW-07	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 102 Faucet	WW-08	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 102 Faucet	WW-09	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 103 Faucet	WW-10	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Room 103	WW-11	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Main Office	WW-12	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 105 Faucet	WW-13	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 106 Faucet	WW-14	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
107 Bathroom Sink	WW-15	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Engineer Breakroom Sink	WW-16	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Engineer Breakroom Sink	WW-17	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across Boy's Bathroom	WW-18	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Elevator, First Floor	WW-19	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Girl's Room, Second Floor	WW-20	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling


Bubbler Across from Room 205	WW-21	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Room 208	WW-22	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 209 Faucet	WW-23	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 211 Faucet	WW-24	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Nurse's Office Faucet	WW-25	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across Boy's Bathroom	WW-26	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Elevator, Second Floor	WW-27	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Art Room, Right Faucet	WW-28	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Art Room	WW-29	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Room 306	WW-30	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Room 311	WW-31	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler Across from Room 315	WW-32	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling
Chiller by Elevator, Third Floor	WW-33	August 30, 2022	5:30 pm	2-3 Minutes	Water Sampling

Attachment F - Pre - Sampling Water Use Certification

TO BE COMPLETED BY THE BAYONNE BOE DISTRICT REPRESENTATIVE:		
School Name: <u>Woodrow Wilson Community</u> <u>School</u>		
Sample collection address:	<u>101 West 56th Street,</u> <u>Bayonne, New Jersey 07002</u>	
Water was last used:	<u>Time: 5:30 pm</u>	<u>Date: August 30, 2022</u>
Sample commencement:	<u>Time: 5:45 am</u>	<u>Date: August 31, 2022</u>
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Scott Nolan	09/30/22	
Signature	Date	


Key:

* = Drinking Water
Sampling Location

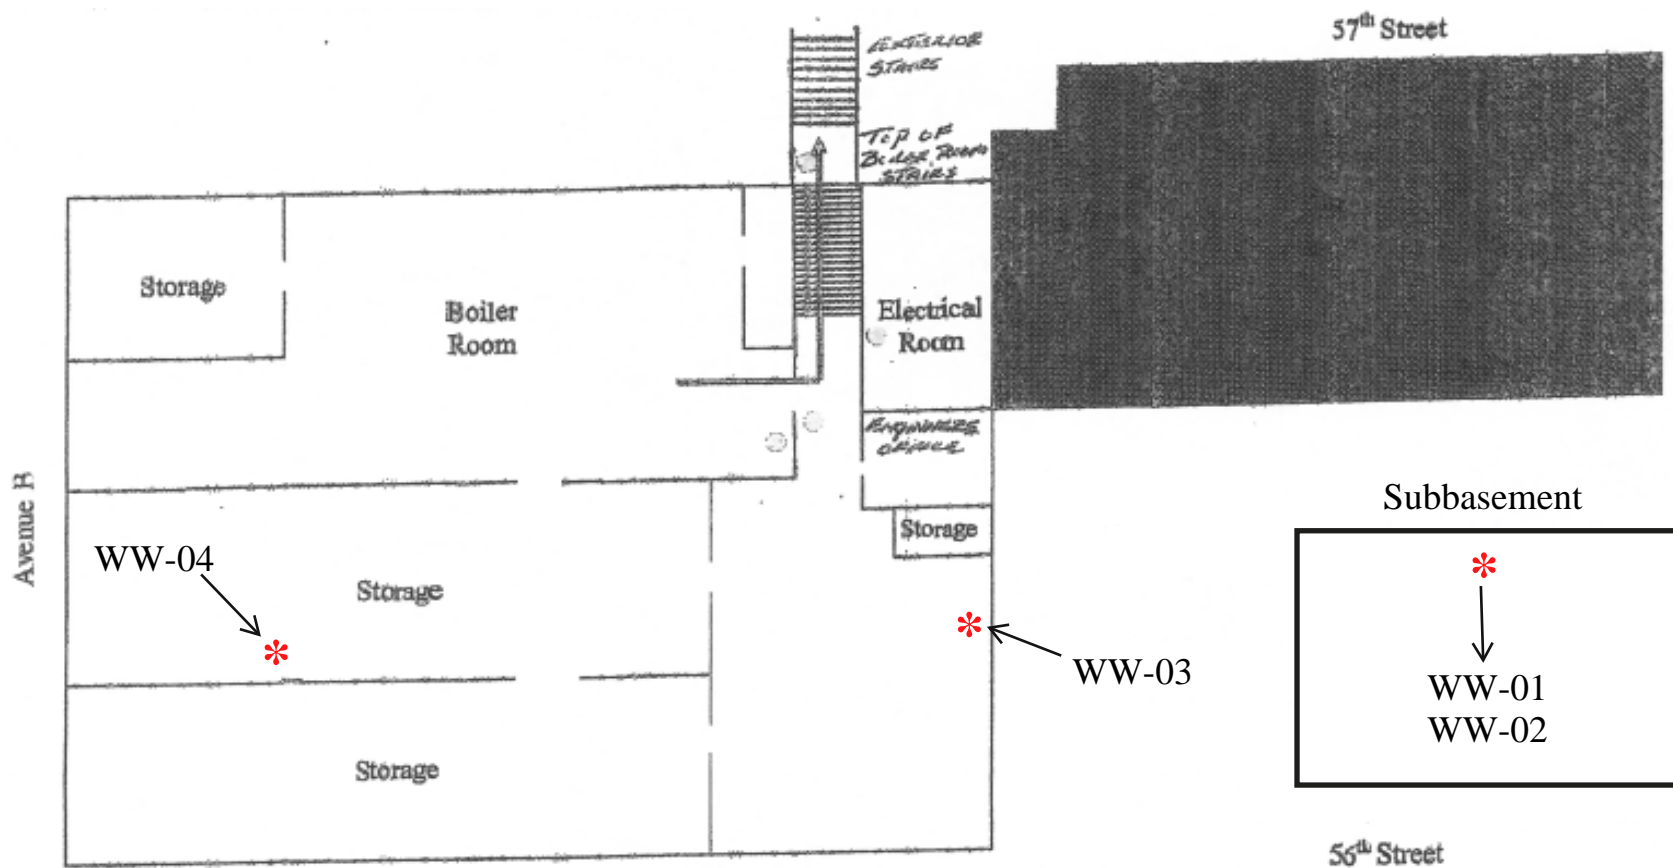

Key:

* = Drinking Water
Sampling Location

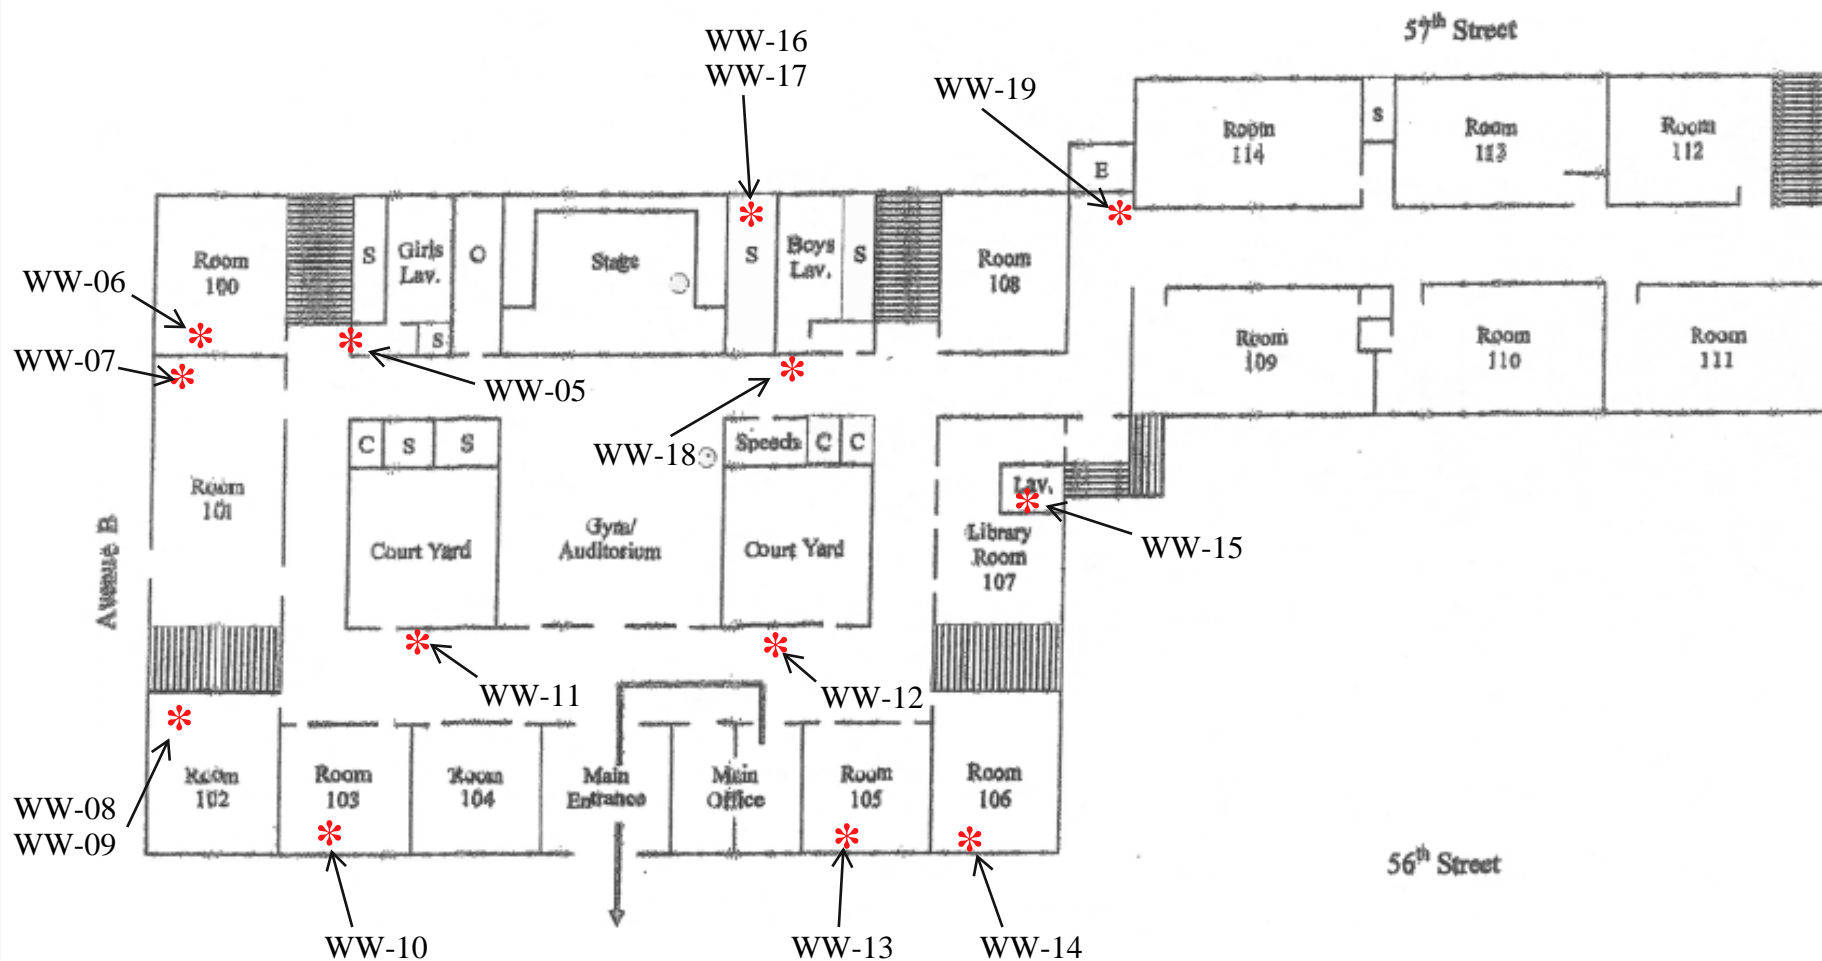

McCABE
ENVIRONMENTAL SERVICES LLC

464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

Project:
Bayonne Bayonne Board of
Education Henry Harris
Community School Lead in
Drinking Water

Drawing Title:
Woodrow Wilson Community School
First Floor Sample Locations


Note:
Not To Scale

MES Project Number: 22-04448

Date:
09/09/2022

Key:

* = Drinking Water
Sampling Location

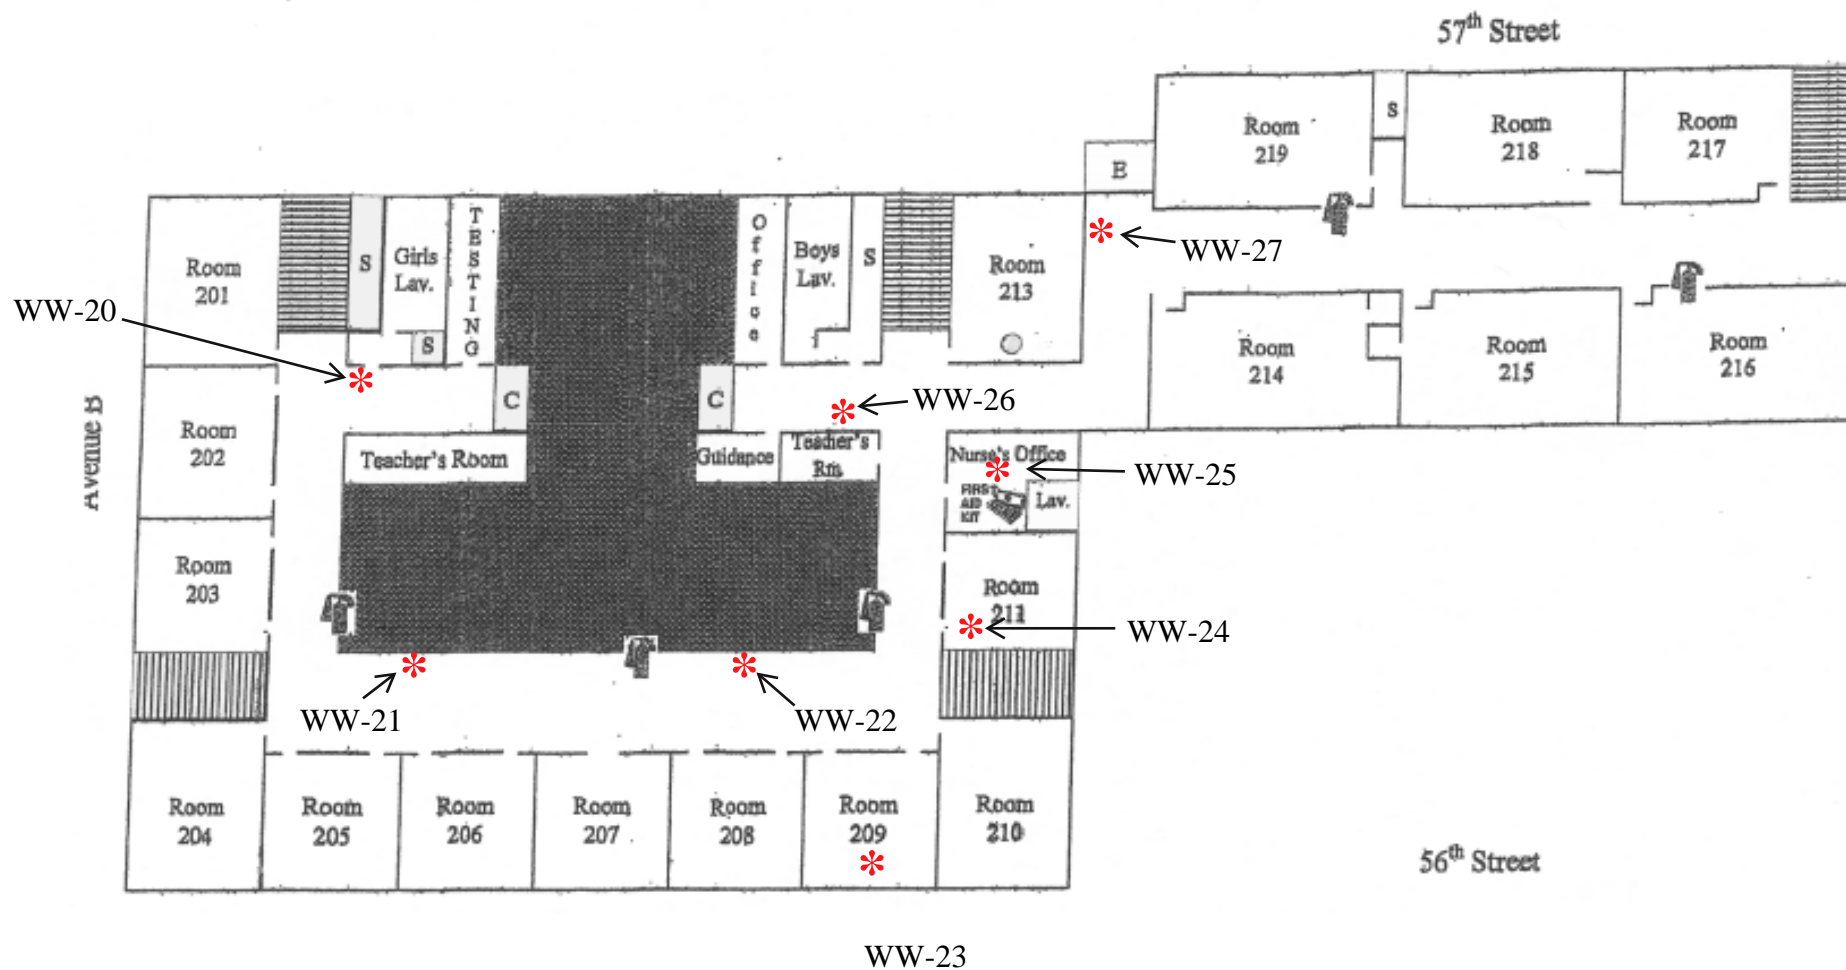

464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

Project:
Bayonne Bayonne Board of
Education Henry Harris
Community School Lead in
Drinking Water

Drawing Title:
Woodrow Wilson Community School
Second Floor Sample Locations

Note:
Not To Scale

MES Project Number: 22-04448

Date:
09/09/2022

Key:

* = Drinking Water
Sampling Location

